



CD/K/025:2009
ICS 71.100.80

EAST AFRICAN STANDARD

Chemicals used for treatment of water intended for human consumption — Liquefied ammonia

EAST AFRICAN COMMUNITY

Foreword

Development of the East African Standards has been necessitated by the need for harmonizing requirements governing quality of products and services in East Africa. It is envisaged that through harmonized standardization, trade barriers which are encountered when goods and services are exchanged within the Community will be removed.

In order to meet the above objectives, the EAC Partner States have enacted an East African Standardization, Quality Assurance, Metrology and Test Act, 2006 (EAC SQMT Act, 2006) to make provisions for ensuring standardization, quality assurance, metrology and testing of products produced or originating in a third country and traded in the Community in order to facilitate industrial development and trade as well as helping to protect the health and safety of society and the environment in the Community.

East African Standards are formulated in accordance with the procedures established by the East African Standards Committee. The East African Standards Committee is established under the provisions of Article 4 of the EAC SQMT Act, 2006. The Committee is composed of representatives of the National Standards Bodies in Partner States, together with the representatives from the private sectors and consumer organizations. Draft East African Standards are circulated to stakeholders through the National Standards Bodies in the Partner States. The comments received are discussed and incorporated before finalization of standards, in accordance with the procedures of the Community.

Article 15(1) of the EAC SQMT Act, 2006 provides that "Within six months of the declaration of an East African Standard, the Partner States shall adopt, without deviation from the approved text of the standard, the East African Standard as a national standard and withdraw any existing national standard with similar scope and purpose".

East African Standards are subject to review, to keep pace with technological advances. Users of the East African Standards are therefore expected to ensure that they always have the latest versions of the standards they are implementing.

© East African Community 2010 — All rights reserved*

East African Community

P O Box 1096

Arusha

Tanzania

Tel: 255 27 2504253/8

Fax: 255-27-2504481/2504255

E-Mail: eac@eachq.org

Web: www.each.int

Introduction

In the preparation of this East African Standard, the following source was consulted extensively:

BS EN 12126:2005, *Chemicals used for treatment of water intended for human consumption — Liquefied ammonia*

Assistance derived from this source and others inadvertently not mentioned is hereby acknowledged.

Draft for comments only — Not to be cited as East African Standard

Chemicals used for treatment of water intended for human consumption — Liquefied ammonia

The European Standard EN 12126:2005 has the status of a
British Standard

ICS 71.100.80

National foreword

This British Standard is the official English language version of EN 12126:2005. It supersedes BS EN 12126:1999 which is withdrawn.

The UK participation in its preparation was entrusted to Technical Committee CII/59, Chemicals for drinking water treatment, which has the responsibility to:

- aid enquirers to understand the text;
- present to the responsible international/European committee any enquiries on the interpretation, or proposals for change, and keep UK interests informed;
- monitor related international and European developments and promulgate them in the UK.

A list of organizations represented on this committee can be obtained on request to its secretary.

The United Kingdom, as a member of CEN, is obliged to publish EN 12126 as a British Standard. However, attention is drawn to the fact that the United Kingdom voted against the approval of EN 12126. The main reason for this disapproval was that the ammonia content is calculated by subtracting the contents of the main impurities from 100%, instead of being determined accurately by an independent method, and no instructions are given for converting the volume fractions of the permanent gases and methane to the mass fractions required for such a calculation.

Cross-references

The British Standards which implement international or European publications referred to in this document may be found in the *BSI Catalogue* under the section entitled "International Standards Correspondence Index", or by using the "Search" facility of the *BSI Electronic Catalogue* or of British Standards Online.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

Compliance with a British Standard does not of itself confer immunity from legal obligations.

Summary of pages

This document comprises a front cover, an inside front cover, the EN title page, pages 2 to 17 and a back cover.

The BSI copyright notice displayed in this document indicates when the document was last issued.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 28 April 2006

© BSI 2006

ISBN 0 580 47481 X

Amendments issued since publication

Amd. No.	Date	Comments

English Version

Chemicals used for treatment of water intended for human consumption - Liquefied ammonia

Produits chimiques utilisés pour le traitement de l'eau destinée à la consommation humaine - Ammoniac liquéfié

Produkte zur Aufbereitung von Wasser für den menschlichen Gebrauch - Ammoniak, flüssig

This European Standard was approved by CEN on 12 May 2005.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Central Secretariat has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

Licensed Copy: KEBS Information Resource Centre, Kenya Bureau of Standards, 16/05/2008 14:09,
 Uncontrolled Copy, (c) BSI

Contents	Page
Foreword	3
Introduction	4
1 Scope	5
2 Normative references	5
3 Description	5
4 Purity criteria	7
Table 1 - Impurities	7
5 Test methods	8
Figure 1 - Typical chromatogram for liquefied ammonia	11
6 Labelling – Transportation – Storage	12
Annex A (informative) General information on liquefied ammonia	15
Annex B (normative) General rules relating to safety	16
Bibliography	17

Foreword

This European Standard (EN 12126:2005) has been prepared by Technical Committee CEN/TC 164 "Water supply", the secretariat of which is held by AFNOR.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by December 2005, and conflicting national standards shall be withdrawn at the latest by December 2005.

This document supersedes EN 12126:1998.

Significant technical differences between this edition and EN 12126:1998 are as follows:

- deletion of the reference to EU Directive 80/778/EEC of 15 July 1980 in order to take account of the latest Directives in force (see [1])

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

Introduction

In respect of potential adverse effects on the quality of water intended for human consumption, caused by the product covered by this European Standard:

- a) this European Standard provides no information as to whether the product may be used without restriction in any of the Member States of the EU or EFTA;
- b) it should be noted that, while awaiting the adoption of verifiable European criteria, existing national regulations concerning the use and/or the characteristics of this product remain in force.

NOTE Conformity with this European Standard does not confer or imply acceptance or approval of the product in any of the Member States of the EU or EFTA. The use of the product covered by this European Standard is subject to regulation or control by National Authorities.

1 Scope

This European Standard is applicable to liquefied ammonia used for treatment of water intended for human consumption. It describes the characteristics and specifies the requirements of liquefied ammonia and refers to the corresponding analytical methods. It gives information for its use in water treatment. It also determines the rules relating to the safe handling and use of liquefied ammonia (see Annex B).

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the reference document (including any amendments) applies.

EN ISO 3696, *Water for analytical laboratory use - Specification and test methods (ISO 3696:1987)*

ISO 7103, *Liquefied anhydrous ammonia for industrial use - Sampling - Taking a laboratory sample.*

ISO 7105, *Liquefied anhydrous ammonia for industrial use - Determination of water content - Karl Fischer Method.*

ISO 7106, *Liquefied anhydrous ammonia for industrial use- Determination of oil content - Gravimetric and infra-red spectrometric methods*

3 Description

3.1 Identification

3.1.1 Chemical name

Ammonia liquefied, anhydrous.

3.1.2 Synonym or common name

Ammonia.

3.1.3 Relative molecular mass

17,03.

3.1.4 Empirical formula

NH₃.

3.1.5 Chemical formula

NH₃.

EN 12126:2005 (E)

3.1.6 CAS Registry Number¹⁾

7664-41-7.

3.1.7 EINECS reference²⁾

231-635-3.

3.2 Commercial form

The product is available as liquefied gas.

3.3 Physical properties

3.3.1 Appearance and odour

The product is colourless liquid with a characteristic pungent odour.

3.3.2 Density

The density of the gas is 0,771 g/l at 101,3 kPa³⁾ and 0 °C.

The density of the liquid is 0,682 g/ml at 101,3 kPa and - 34 °C, and 0,61 g/ml at 850 kPa and 20 °C.

3.3.3 Solubility (in water)

The solubility of the product in water is 900 g/l at 0 °C, 520 g/l at 20 °C, and 407 g/l at 30 °C.

3.3.4 Vapour pressure

The vapour pressure of the product is 400 kPa at 0 °C, 850 kPa at 20 °C and 2 035 kPa at 50 °C.

3.3.5 Boiling point at 100 kPa³⁾

The boiling point of the product is -33,4 °C at 101,3 kPa.

3.3.6 Melting point

The melting point of the product is -77,7 °C at 101,3 kPa.

3.3.7 Specific heat

The specific heat of the product is 4,61 kJ/(kg K) at 0 °C and 4,86 kJ/(kg K) at 40 °C.

3.3.8 Viscosity, dynamic

The viscosity of the product is 0,254 mPa.s at 33 °C and 101,3 kPa.

¹⁾ Chemical Abstracts Service Registry Number.

²⁾ European Inventory of Existing Commercial Chemical Substances.

³⁾ 100 kPa = 1 bar.

3.3.9 Critical temperature

132,4 °C.

3.3.10 Critical pressure

11 450 kPa.

3.3.11 Physical hardness

Not applicable.

3.4 Chemical properties

Ammonia reacts violently with halogens, acids, acid halides, acid anhydrides and oxidizing agents. It reacts with zinc, copper, tin and their alloys. Mixtures of volume fraction of 15 % to 30 % of ammonia with air are explosive.

4 Purity criteria**4.1 General**

This European Standard specifies the minimum purity requirements for liquefied ammonia used for the treatment of water intended for human consumption. Limits are given for impurities commonly present in the product. Depending on the raw material and the manufacturing process other impurities may be present and, if so, this shall be notified to the user and when necessary to relevant authorities.

NOTE Users of this product should check the national regulations in order to clarify whether it is of appropriate purity for treatment of water intended for human consumption, taking into account raw water quality, required dosage, contents of other impurities and additives used in the product not stated in this product standard.

Limits have been given for impurities and chemical parameters where these are likely to be present in significant quantities from the current production process and raw materials. If the production process or raw materials leads to significant quantities of impurities, by-products or additives being present, this shall be notified to the user.

4.2 Composition of commercial product

Liquefied ammonia shall not contain less than a mass fraction of 99,8 % of NH₃.

4.3 Impurities and main by-products

The product shall conform to the requirements specified in Table 1.

Table 1 - Impurities

Impurity		Limit
Water	max.	Mass fraction 0,1 %
Permanent gases and methane	max.	Volume fraction 0,1 %
Oil	max.	5 mg/kg

4.4 Chemical parameters

The chemicals parameters defined in the EU Water Directive (see [1]) are not found in liquefied ammonia. Cyanides, pesticides and polycyclic aromatic hydrocarbons are not by-products of the manufacturing process.

5 Test methods

5.1 Sampling

Follow the sampling method according to ISO 7103.

5.2 Analyses

5.2.1 Main product

The ammonia concentration is calculated by subtracting the contents of the main impurities from mass fraction 100 %.

5.2.2 Impurities

5.2.2.1 Water

The water content shall be determined in accordance with ISO 7105.

5.2.2.2 Oil content

The oil content shall be determined in accordance with ISO 7106.

5.2.3 Permanent gases and methane

5.2.3.1 Principle

The method is a gas chromatographic determination of inert gases and methane in liquid ammonia, determined as a volume fraction.

The content of trace contaminants is determined by gas chromatography according to an external standard method. Metering from the gas pipette is carried out by means of pressure-controlled feed via a fixed-volume sampling valve.

Liquefied ammonia is evaporated prior to the gas chromatographic test in a special steel gas pipette.

5.2.3.2 Reagents and materials

5.2.3.2.1 Reagents

All reagents shall be of a recognized analytical grade and the water used shall conform to the grade 3 specified in EN ISO 3696.

5.2.3.2.2 Carrier gas

Helium, minimum purity volume fraction 99,9 %.

5.2.3.2.3 Calibration gas mixture of the following composition:

- hydrogen volume fraction 91 %;
- nitrogen volume fraction 5 %;
- methane volume fraction 3 %;
- sum of oxygen and argon volume fraction 1 %.

5.2.3.2.4 Material for preparation of the column

Molecular sieve 13 X of particle size 250 µm to 360 µm, or any other equivalent suitable material.

5.2.3.3 Apparatus**5.2.3.3.1 Gas chromatographic apparatus**

Any suitable gas chromatograph, fitted with a thermal conductivity detector, can be used.

5.2.3.3.1.1 Characteristics of the gas chromatographic apparatus

- Column temperature: typically 40 °C isothermal conditions.
- Detector temperature: typically 130 °C.
- Filament temperature: typically 200 °C.

5.2.3.3.1.2 Carrier gas flow rate

The carrier gas flow rate shall be approximately 25 ml/min. It is usually measured at column outlet and at ambient temperature.

5.2.3.3.2 Injection equipment

Stainless steel gas sample valve with a loop of 2 ml capacity, operating under the following conditions:

- temperature: ambient to 50 °C;
- pressure: atmospheric.

5.2.3.3.3 Column**5.2.3.3.3.1 Construction**

The column can be made of any suitable material that does not react with the test portion, for example stainless steel. Typical dimensions are as follows:

- a) length: according to the test method used but typically 4 m;
- b) diameter: internal diameter approximately 3,2 mm ; external diameter approximately 6 mm;
- c) shape: adapted to the oven geometry. If coiled, the coil diameter shall be at least ten times the outer diameter of the tube.

5.2.3.3.3.2 Packing

5.2.3.3.3.2.1 Composition

Molecular sieve (see 5.2.3.2.4).

5.2.3.3.3.2.2 Method of packing

Use a standardized procedure to give a packed column capable of separating the permanent gas and methane.

5.2.3.3.3.3. Thermal conductivity detector, of such sensitivity that the height of the permanent gas and methane peaks to be measured at the limit of detection is not less than twice the peak-to-noise level.

5.2.3.3.3.4 Recorder

The development of the retention time shall be approximately 10 min.

5.2.3.4 Procedure

5.2.3.4.1 Setting up the chromatograph

Set up the chromatograph as specified in 5.2.3.2 and 5.2.3.3.

5.2.3.4.2 Determination of the area correction factor

Approximately 25 kPa(p) of the calibrating gas is precisely metered into the gas chromatographic system and chromatographed under the conditions specified in 5.2.3.2 and 5.2.3.3. The peak areas are determined and the area correction factors calculated in accordance with 5.2.3.5.1.


5.2.3.4.3 Determination

To determine methane and inert gases, approximately 90 kPa (p_g) of the gas sample is precisely metered in via a 2 ml sampling valve and chromatographed under the conditions specified in 5.2.3.2 and 5.2.3.3. The peak areas are determined and the volume fraction is calculated in accordance with 5.2.3.5.2.

5.2.3.4.4 Examination of the chromatogram

5.2.3.4.4.1 Typical chromatogram

See Figure 1.

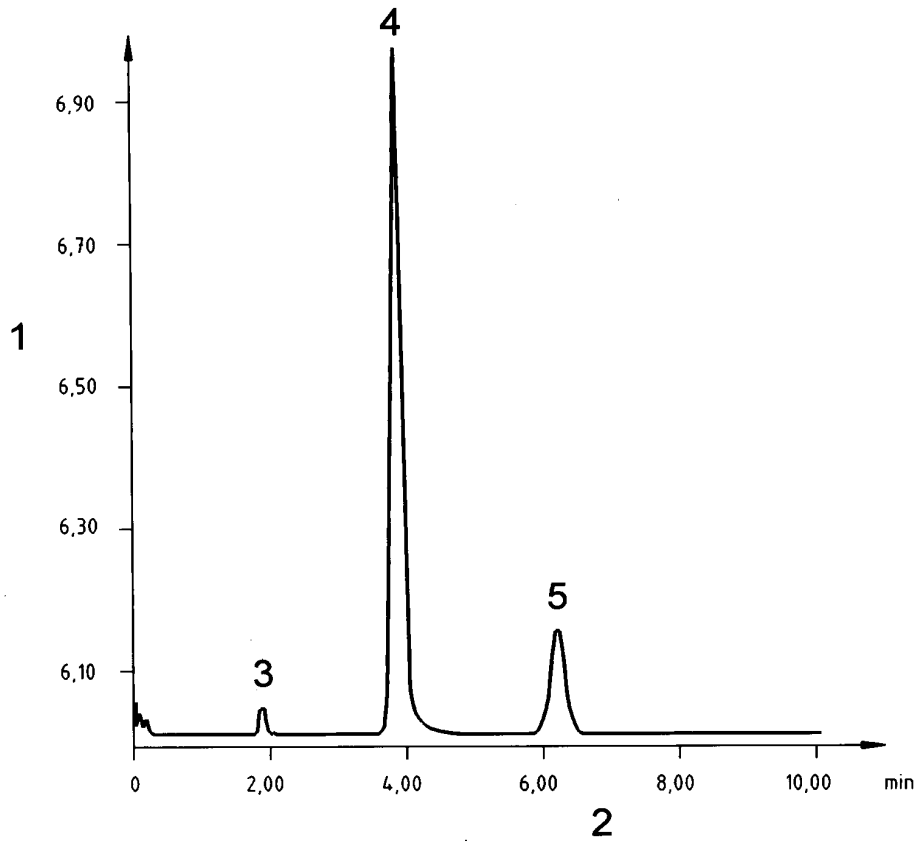

Key

- 1) Amplitude
- 2) Retention time in minutes
- 3) Oxygen
- 4) Nitrogen
- 5) Methane

Figure 1 - Typical chromatogram for liquefied ammonia

5.2.3.4.4.2 Retention time

The retention time is approximately 10 min.

5.2.3.5 Calculations

5.2.3.5.1 Calculation of the area correction factors (f_i)

The area correction factor for oxygen, for nitrogen and for methane (f_i) is calculated by the following equation:

$$f_i = \frac{\rho \times \varphi_i}{A_i} \quad (1)$$

where:

ρ is the feed pressure in kilopascals;

φ_i is the volume fraction in % of oxygen, nitrogen or methane;

A_i is the area of the peak of oxygen, nitrogen or methane.

5.2.3.5.2 Expression of results

The content of oxygen, nitrogen or methane, expressed as a volume fraction in % is given by the following equation:

$$\varphi_i = \frac{A_i \times f_i}{\rho_s} \quad (2)$$

where:

ρ_s is the sample feed pressure in kilopascals.

5.2.3.6 Determination limit, detection limit

The determination limit of the method is a volume fraction of 0,001 0 % and the detection limit is a volume fraction of 0,000 3 %

6 Labelling – Transportation – Storage

6.1 Means of delivery

The product shall be delivered in suitable pressure containers.

In order that the purity of the product is not affected, the means of delivery shall not have been used previously for any different product or it shall have been specially cleaned and prepared before use.

6.2 Risk and safety labelling according to the EU Directives ⁴⁾

The following labelling requirements apply to liquefied ammonia at the date of the publication of this European Standard:

- symbols and indication of danger:

T: toxic

- nature of special risks attributed to dangerous substances:

R 10: Flammable;
R 23: Toxic by inhalation.

- safety advice concerning dangerous substances:

S 16: Keep away from sources of ignition - No smoking;
S 38: In case of insufficient ventilation, wear suitable respiratory equipment;
S 45: In case of accident or if you feel unwell, seek medical advice immediately (show the label where possible).

S 7/9: Keep container tightly closed and in a well-ventilated place.

6.3 Transportation regulations and labelling

Liquefied ammonia is listed as UN Number⁵⁾ N° 1005.

RID⁶⁾: class 2; classification code 2TC.

ADR⁷⁾: class 2 ; classification code 2TC.

IMDG⁸⁾: class 2 label 2.3.

IATA⁹⁾: class 2 label 2.3.

6.4 Marking

The marking shall include the following:

- the name "liquefied ammonia", trade name and grade;

4) See [2].

5) United Nations Number.

6) Regulations concerning International carriage of Dangerous Goods by rail.

7) European Agreement concerning the international carriage of Dangerous goods by Road.

8) International Maritime Transport of Dangerous Goods.

9) International Air Transport Association.

EN 12126:2005 (E)

- the net mass;
- the name and the address of supplier and/or manufacturer;
- the statement "this product conforms to EN 12126".

6.5 Storage

6.5.1 Long term stability

Decomposition begins at 450 °C. Ammonia does not decompose when stored and handled correctly.

6.5.2 Storage incompatibilities

Containers shall be kept tightly closed in a cool, well-ventilated place and handled with care. Avoid contact with halogens, acid anhydrides, oxidizing agents, zinc, copper, tin and their alloys.

Annex A (informative)

General information on liquefied ammonia

A.1 Origin

A.1.1 Raw materials

Liquefied ammonia is manufactured from nitrogen and hydrogen.

A.1.2 Manufacturing process

Nitrogen and hydrogen are combined to produce ammonia in the "Haber-Bosch process".

A.2 Use

A.2.1 Function

The function of liquefied ammonia in water treatment is bacteriostatic treatment, after reaction with chlorine in water solution to form chloramine.

A.2.2 Form in which it is used

See A 2.4.

A.2.3 Treatment dose

The usual treatment dose of chloramine is 1 mg/l expressed as chlorine, corresponding to 0,3 mg/l expressed as NH₃.

A.2.4 Means of application

Liquefied ammonia is evaporated, then dissolved in water and injected in the water to be treated.

A.2.5 Secondary effects

Increase of pH-value, if excessive amounts are added.

A.2.6 Removal of excess product

Not applicable.

Annex B (normative)

General rules relating to safety

B.1 Rules for safe handling and use

The supplier shall provide current safety instructions.

B.2 Emergency procedures

B.2.1 First aid

In case of contact with the eyes treat by thorough irrigation with water, with the eyelids held open. Consult a doctor (or eye specialist) immediately.

In case of contact with the skin take off immediately all contaminated clothing and wash with plenty of water. Do not rub frozen parts of the body, instead provide sterilized protective bandage. Seek medical advice immediately.

After inhalation move for fresh air treatment, keep patient calm and warm. If the patient stops breathing, provide artificial respiration. Seek medical advice immediately.

In case of ingestion seek medical advice immediately. Do not induce vomiting. If patient is conscious, get him to drink plenty of water (or acetic acid of mass fraction of 1 % to 2 % or lemon juice) immediately. In any case consult a physician.

B.2.2 Spillage

After spillage/leakage/gas leakage, spray water to trap the gas escaping from containers or arising from leaked product. Do not spray water into liquid ammonia. Cover with ammonia-resistant medium expansion foam and pump into suitable containers under expert supervision. Use the necessary personal protective equipment when handling.

B.2.3 Fire

Extinguishing media: Foam. Do not use water.

Bibliography

- [1] 98/83/EC, *Council Directive of 3 November 1998 on the quality of water intended for human consumption.*
- [2] 67/548/EEC, *Council Directive of 27th June 1967 on the approximation of the laws, regulations and administrative provisions relating to the classification, packaging and labelling of dangerous substances and its amendments and adaptations.*

BSI
389 Chiswick High Road
London
W4 4AL

BSI — British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover.
Tel: +44 (0)20 8996 9000. Fax: +44 (0)20 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: +44 (0)20 8996 9001.
Fax: +44 (0)20 8996 7001. Email: orders@bsi-global.com. Standards are also available from the BSI website at <http://www.bsi-global.com>.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre.
Tel: +44 (0)20 8996 7111. Fax: +44 (0)20 8996 7048. Email: info@bsi-global.com.

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration.
Tel: +44 (0)20 8996 7002. Fax: +44 (0)20 8996 7001.
Email: membership@bsi-global.com.

Information regarding online access to British Standards via British Standards Online can be found at <http://www.bsi-global.com/bsonline>.

Further information about BSI is available on the BSI website at <http://www.bsi-global.com>.

Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

Details and advice can be obtained from the Copyright & Licensing Manager.
Tel: +44 (0)20 8996 7070. Fax: +44 (0)20 8996 7553.
Email: copyright@bsi-global.com.

Draft for comments only — Not to be cited as East African Standard