



CD/K/029-2:2009
ICS 23.040.20; 23.040.45; 91.140.60; 93.025

EAST AFRICAN STANDARD

**Plastics piping systems for hot and cold water installations —
Polypropylene (PP) — Part 2: Pipes**

EAST AFRICAN COMMUNITY

Foreword

Development of the East African Standards has been necessitated by the need for harmonizing requirements governing quality of products and services in East Africa. It is envisaged that through harmonized standardization, trade barriers which are encountered when goods and services are exchanged within the Community will be removed.

In order to meet the above objectives, the EAC Partner States have enacted an East African Standardization, Quality Assurance, Metrology and Test Act, 2006 (EAC SQMT Act, 2006) to make provisions for ensuring standardization, quality assurance, metrology and testing of products produced or originating in a third country and traded in the Community in order to facilitate industrial development and trade as well as helping to protect the health and safety of society and the environment in the Community.

East African Standards are formulated in accordance with the procedures established by the East African Standards Committee. The East African Standards Committee is established under the provisions of Article 4 of the EAC SQMT Act, 2006. The Committee is composed of representatives of the National Standards Bodies in Partner States, together with the representatives from the private sectors and consumer organizations. Draft East African Standards are circulated to stakeholders through the National Standards Bodies in the Partner States. The comments received are discussed and incorporated before finalization of standards, in accordance with the procedures of the Community.

Article 15(1) of the EAC SQMT Act, 2006 provides that "Within six months of the declaration of an East African Standard, the Partner States shall adopt, without deviation from the approved text of the standard, the East African Standard as a national standard and withdraw any existing national standard with similar scope and purpose".

East African Standards are subject to review, to keep pace with technological advances. Users of the East African Standards are therefore expected to ensure that they always have the latest versions of the standards they are implementing.

© East African Community 2010 — All rights reserved*

East African Community

P O Box 1096

Arusha

Tanzania

Tel: 255 27 2504253/8

Fax: 255-27-2504481/2504255

E-Mail: eac@eachq.org

Web: www.each.int

Introduction

In the preparation of this East African Standard, the following source was consulted extensively:

ISO 15874-2:2003, *Plastics piping systems for hot and cold water installations — Polypropylene (PP) — Part 2: Pipes*

Assistance derived from this source and others inadvertently not mentioned is hereby acknowledged.

Draft for comments only — Not to be cited as East African Standard

INTERNATIONAL
STANDARD

ISO
15874-2

First edition
2003-12-01

**Plastics piping systems for hot and cold
water installations — Polypropylene
(PP) —**

**Part 2:
Pipes**

*Systèmes de canalisations en plastique pour les installations d'eau
chaude et froide — Polypropylène (PP) —*

Partie 2: Tubes



Reference number
ISO 15874-2:2003(E)

© ISO 2003

PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

© ISO 2003

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 15874-2 was prepared by the European Committee for Standardization (CEN) in collaboration with Technical Committee ISO/TC 138, *Plastics pipes, fittings and valves for the transport of fluids*, Subcommittee SC 2, *Plastics pipes and fittings for water supplies*, in accordance with the Agreement on technical cooperation between ISO and CEN (Vienna Agreement).

Throughout the text of this document, read “...this European Standard...” to mean “...this International Standard...”.

ISO 15874 consists of the following parts, under the general title *Plastics piping systems for hot and cold water installations — Polypropylene (PP)*:

- *Part 1: General*
- *Part 2: Pipes*
- *Part 3: Fittings*
- *Part 5: Fitness for purpose of the system*
- *Part 7: Guidance for the assessment of conformity* [Technical Specification]

Contents

page

Foreword	v
Introduction	vi
1 Scope	1
2 Normative references	1
3 Terms and definitions, symbols and abbreviated terms	2
4 Material	2
4.1 Pipe material	2
4.2 Evaluation of σ_{LCL} -values	2
4.3 Influence on water intended for human consumption	6
5 General characteristics	6
5.1 Appearance	6
5.2 Opacity	6
6 Geometrical characteristics	6
6.1 General.....	6
6.2 Dimensions of pipes.....	7
7 Mechanical characteristics	10
8 Physical and chemical characteristics	10
9 Performance requirements	11
10 Marking	11
10.1 General requirements	11
10.2 Minimum required marking.....	12
Annex A (informative) Derivation of $S_{calc,max}$	13
A.1 General.....	13
A.2 Design stress	13
A.3 Derivation of maximum value of S_{calc} ($S_{calc,max}$)	14
A.4 Use of $S_{calc,max}$ to determine wall thickness.....	15
Bibliography	16

Draft for comments only — Not to be cited as East African Standard

Foreword

This document (EN ISO 15874-2:2003) has been prepared by Technical Committee CEN/TC 155 "Plastics piping systems and ducting systems", the secretariat of which is held by NEN, in collaboration with Technical Committee ISO/TC 138 "Plastics pipes, fittings and valves for the transport of fluids".

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by June 2004, and conflicting national standards shall be withdrawn at the latest by December 2005.

NOTE 1 This standard was submitted for CEN enquiry as prEN 12202-2:1995.

This standard is part of a System Standard for plastics piping systems of a particular material for a specified application. There are a number of such System Standards.

System Standards are based on the results of the work undertaken in ISO/TC 138 "Plastics pipes, fittings and valves for the transport of fluids", which is a Technical Committee of the International Organization for Standardization (ISO).

They are supported by separate Standards on test methods to which references are made throughout the System Standard.

The System Standards are consistent with general standards on functional requirements and recommended practices for installation.

EN ISO 15874 consists of the following Parts ¹⁾, under the general title *Plastics piping systems for hot and cold water installations — Polypropylene (PP)*

- Part 1: General
- Part 2: Pipes (the present standard)
- Part 3: Fittings
- Part 5: Fitness for purpose of the system
- Part 7: Guidance for the assessment of conformity (CEN ISO/TS 15874-7).

This Part of EN ISO 15874 includes the following:

- Annex A (informative): Derivation of $S_{calc,max}$
- Bibliography

At the date of publication of this standard, System Standards for piping systems of other plastics materials used for the same application are the following:

EN ISO 15875, *Plastics piping systems for hot and cold water installations — Crosslinked polyethylene (PE-X) (ISO 15875:2003)*

EN ISO 15876, *Plastics piping systems for hot and cold water installations — Polybutylene (PB) (ISO 15876:2003)*

EN ISO 15877, *Plastics piping systems for hot and cold water installations — Chlorinated poly(vinyl chloride) (PVC-C) (ISO 15877:2003)*

For pipes and fittings which have conformed to the relevant national standard before 1st November 2003, as shown by the manufacturer or by a certification body, the national standard may continue to apply until 30th November 2005.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Luxembourg, Malta, Netherlands, Norway, Portugal, Slovakia, Spain, Sweden, Switzerland and the United Kingdom.

1) This System Standard does not incorporate a Part 4 *Ancillary equipment* or a Part 6: *Guidance for installation*. For ancillary equipment separate standards can apply. Guidance on installation of plastics piping systems made from different materials, intended to be used for hot and cold water installations, is given by ENV 12108 ^[1].

Introduction

The System Standard, of which this is Part 2, specifies the requirements for a piping system when made from polypropylene (PP). The piping system is intended to be used for hot and cold water installations.

In respect of potential adverse effects on the quality of water intended for human consumption, caused by the product covered by this standard:

- This standard provides no information as to whether the product may be used without restriction in any of the Member States of the EU or EFTA;
- It should be noted that, while awaiting the adoption of verifiable European criteria, existing national regulations concerning the use and/or the characteristics of this product remain in force.

Requirements and test methods for material and components, other than pipes, are specified in Part 1 and Part 3 of EN ISO 15874:2003. Characteristics for fitness for purpose (mainly for joints) are covered in Part 5. Part 7 (CEN ISO/TS 15874-7:2003) gives guidance for the assessment of conformity.

This part of EN ISO 15874 specifies the characteristics of pipes.

1 Scope

This part of EN ISO 15874 specifies the characteristics of pipes made from polypropylene (PP) for piping systems intended to be used for hot and cold water installations within buildings for the conveyance of water whether or not intended for human consumption (domestic systems) and for heating systems under operating pressures and temperatures appropriate to the class of application (see Table 1 of EN ISO 15874-1:2003).

This standard covers a range of service conditions (application classes), design pressures and pipe dimension classes. For values of T_D , T_{max} and T_{mal} in excess of those in Table 1 of Part 1, this standard does not apply.

NOTE 1 It is the responsibility of the purchaser or specifier to make the appropriate selections from these aspects, taking into account their particular requirements and any relevant national regulations and installation practices or codes.

It also specifies the test parameters for the test methods referred to in this standard.

In conjunction with the other parts of EN ISO 15874 (see Foreword) it is applicable to PP pipes, their joints and to joints with components of PP, other plastics and non-plastics materials intended to be used for hot and cold water installations.

It is applicable to pipes with or without (a) barrier layer(s).

NOTE 2 In the case of plastics pipes provided with a thin barrier layer, e.g. to prevent or greatly diminish the diffusion of gases and the transmission of light into or through the pipe wall, the design stress requirements are totally met by the base polymer (PP).

2 Normative references

This standard incorporates by dated or undated reference, provisions from other publications. These normative references are cited at the appropriate places in the text and the publications are listed hereafter. For dated references, subsequent amendments to, or revisions of, any of these publications apply to this standard only when incorporated in it by amendment or revision. For undated references the latest edition of the publication referred to applies (including amendments).

EN 578, *Plastics piping systems — Plastics pipes and fittings — Determination of the opacity*

EN 743:1994, *Plastics piping and ducting systems — Thermoplastics pipes — Determination of the longitudinal reversion*

EN 921:1994, *Plastics piping systems — Thermoplastics pipes — Determination of resistance to internal pressure at constant temperature*

EN ISO 15874-1:2003, *Plastics piping systems for hot and cold water installations — Polypropylene (PP) — Part 1: General (ISO 15874-1:2003)*

EN ISO 15874-5, *Plastics piping systems for hot and cold water installations — Polypropylene (PP) — Part 5: Fitness for purpose of the system (ISO 15874-5:2003)*

EN ISO 3126, *Plastics piping systems — Plastics components — Measurement of dimensions (ISO 3126:2003)*

EN ISO 9080, *Plastics piping and ducting systems — Determination of the long-term hydrostatic strength of thermoplastics materials in pipe form by extrapolation (ISO 9080:2003)*

ISO 1133, *Plastics — Determination of the melt mass-flow rate (MFR) and the melt volume-flow rate (MVR) of thermoplastics*

ISO 9854-1, *Thermoplastics pipes for the transport of fluids — Determination of pendulum impact strength by the Charpy method — Part 1: General test method*

ISO 9854-2, *Thermoplastics pipes for the transport of fluids — Determination of pendulum impact strength by the Charpy method — Part 2: Test conditions for pipes of various materials*

3 Terms and definitions, symbols and abbreviated terms

For the purposes of this standard the terms and definitions, symbols and abbreviated terms given in EN ISO 15874-1:2003 apply.

4 Material

4.1 Pipe material

The material from which the pipe is made shall be polypropylene (PP).

4.2 Evaluation of σ_{LCL} -values

The pipe material shall be evaluated in accordance with EN ISO 9080 or equivalent where internal pressure tests are made in accordance with EN 921:1994 to find the σ_{LCL} -values. The σ_{LCL} -value thus determined shall at least be as high as the corresponding values of the reference curves given in Figure 1, 2 or 3, over the complete range of times in Figure 1, 2 or 3.

NOTE 1 One equivalent way of evaluation is to calculate the σ_{LCL} -value for each temperature (for example 20 °C, 60 °C and 95 °C) individually.

NOTE 2 The reference curves in Figures 1, 2 and 3 in the temperature range of 10 °C to 95 °C are derived from the following equations: First branch (i.e. the left hand portion of the lines as shown in Figures 1, 2 and 3)

$$\text{for PP-H: } \log t = -46,364 - \frac{9601,1 \log \sigma}{T} + \frac{20381,5}{T} + 15,24 \log \sigma \quad (1)$$

$$\text{for PP-B: } \log t = -56,086 - \frac{10157,8 \log \sigma}{T} + \frac{23971,7}{T} + 13,32 \log \sigma \quad (2)$$

$$\text{for PP-R: } \log t = -55,725 - \frac{9484,1 \log \sigma}{T} + \frac{25502,2}{T} + 6,39 \log \sigma \quad (3)$$

Second branch (i. e. the right hand portion of the lines as shown in Figures 1, 2 and 3)

$$\text{for PP-H: } \log t = -18,387 + \frac{8918,5}{T} - 4,1 \log \sigma \quad (4)$$

$$\text{for PP-B: } \log t = -13,699 + \frac{6970,3}{T} - 3,82 \log \sigma \quad (5)$$

$$\text{for PP-R: } \log t = -19,98 + \frac{9507}{T} - 4,11 \log \sigma \quad (6)$$

To demonstrate conformance to the reference lines pipe samples should be tested at following temperatures and at various hoop stresses such that, at each of the temperatures given, at least three failure times fall in each of the following time intervals:

Temperatures 20; 60-70; 95; °C;

Time intervals 10-100 h, 100-1000 h, 1000-8760 h and above 8760 h.

In tests lasting more than 8760 h, once failure is reached at a stress and time at least on or above the reference line, any time after that can be considered as the failure time. Testing should be carried out in accordance with EN 921:1994.

Conformance with the reference lines should be demonstrated by plotting the individual experimental results on the graph. At least 97.5% of them should lie on or above the reference line.

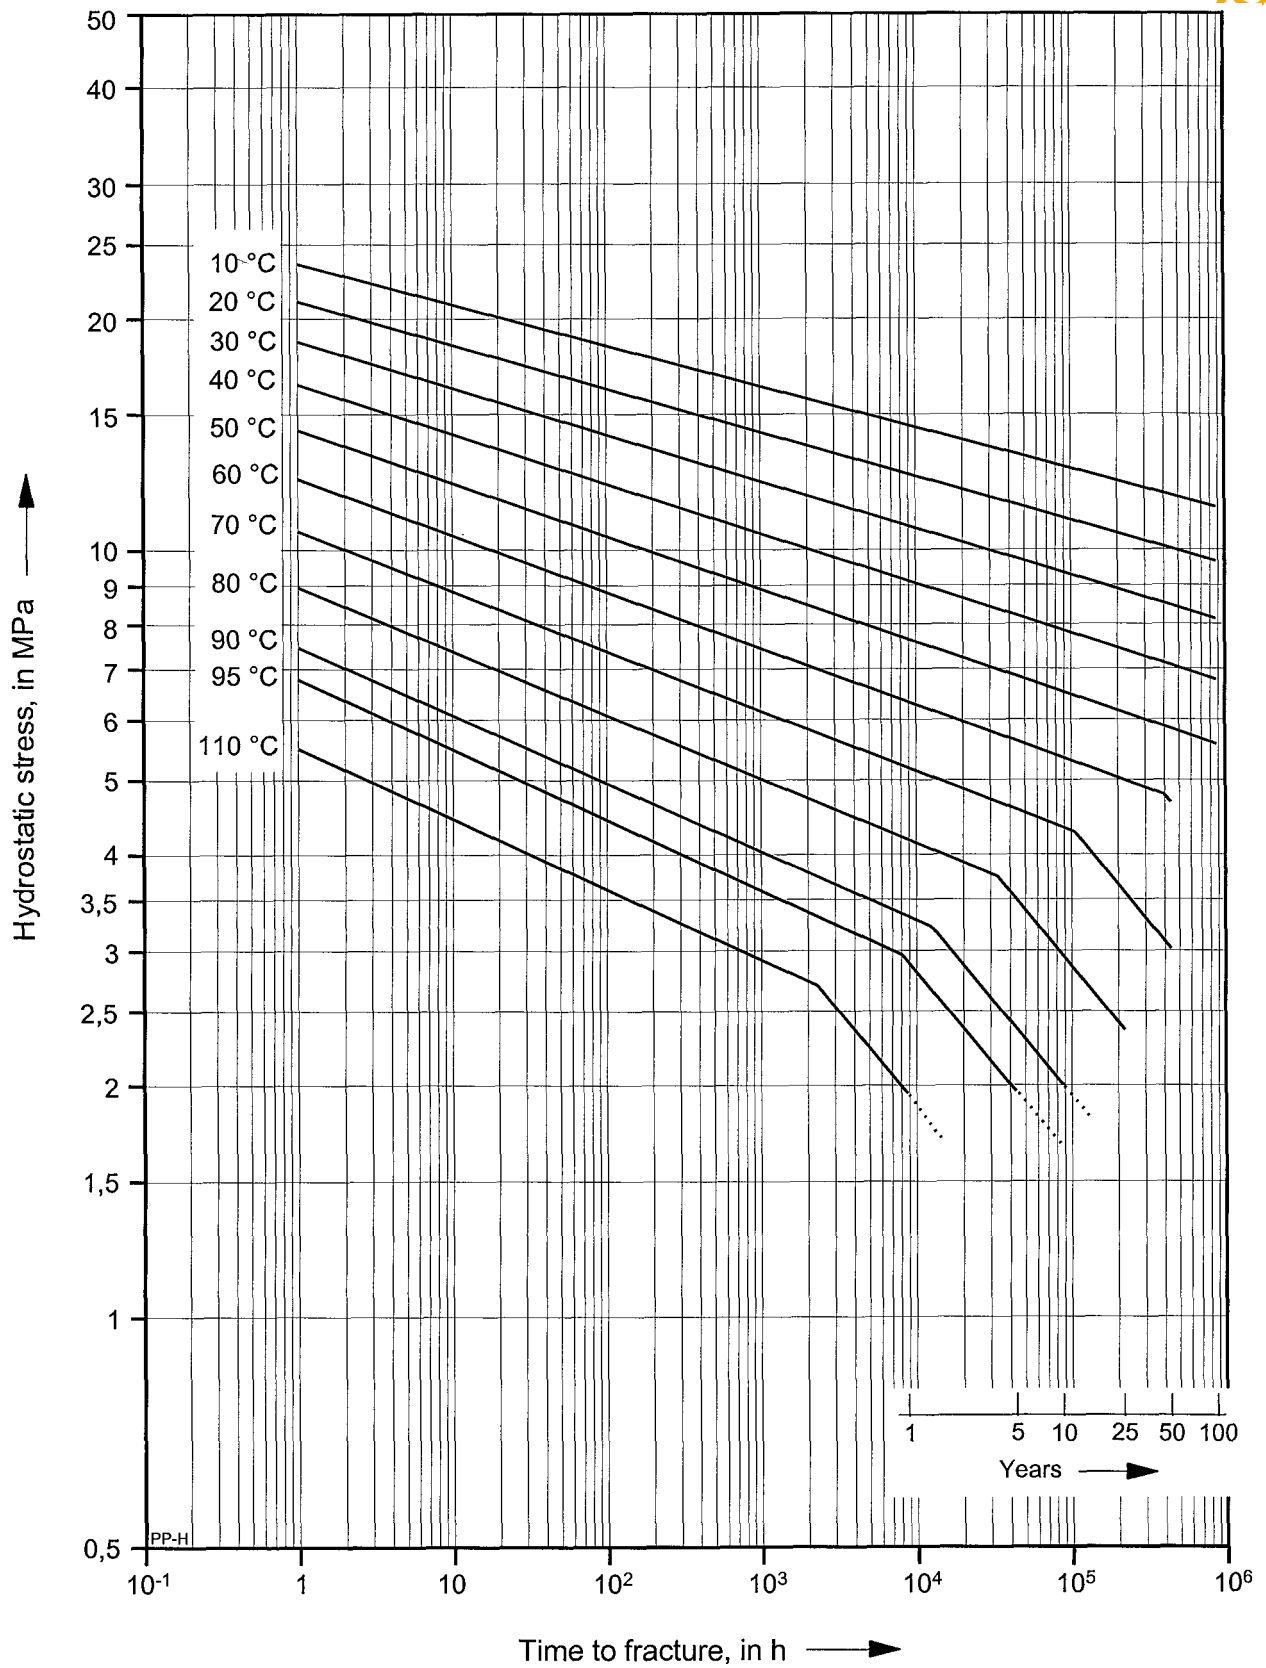


Figure 1 — Reference curves for expected strength of polypropylene homopolymer

Draft

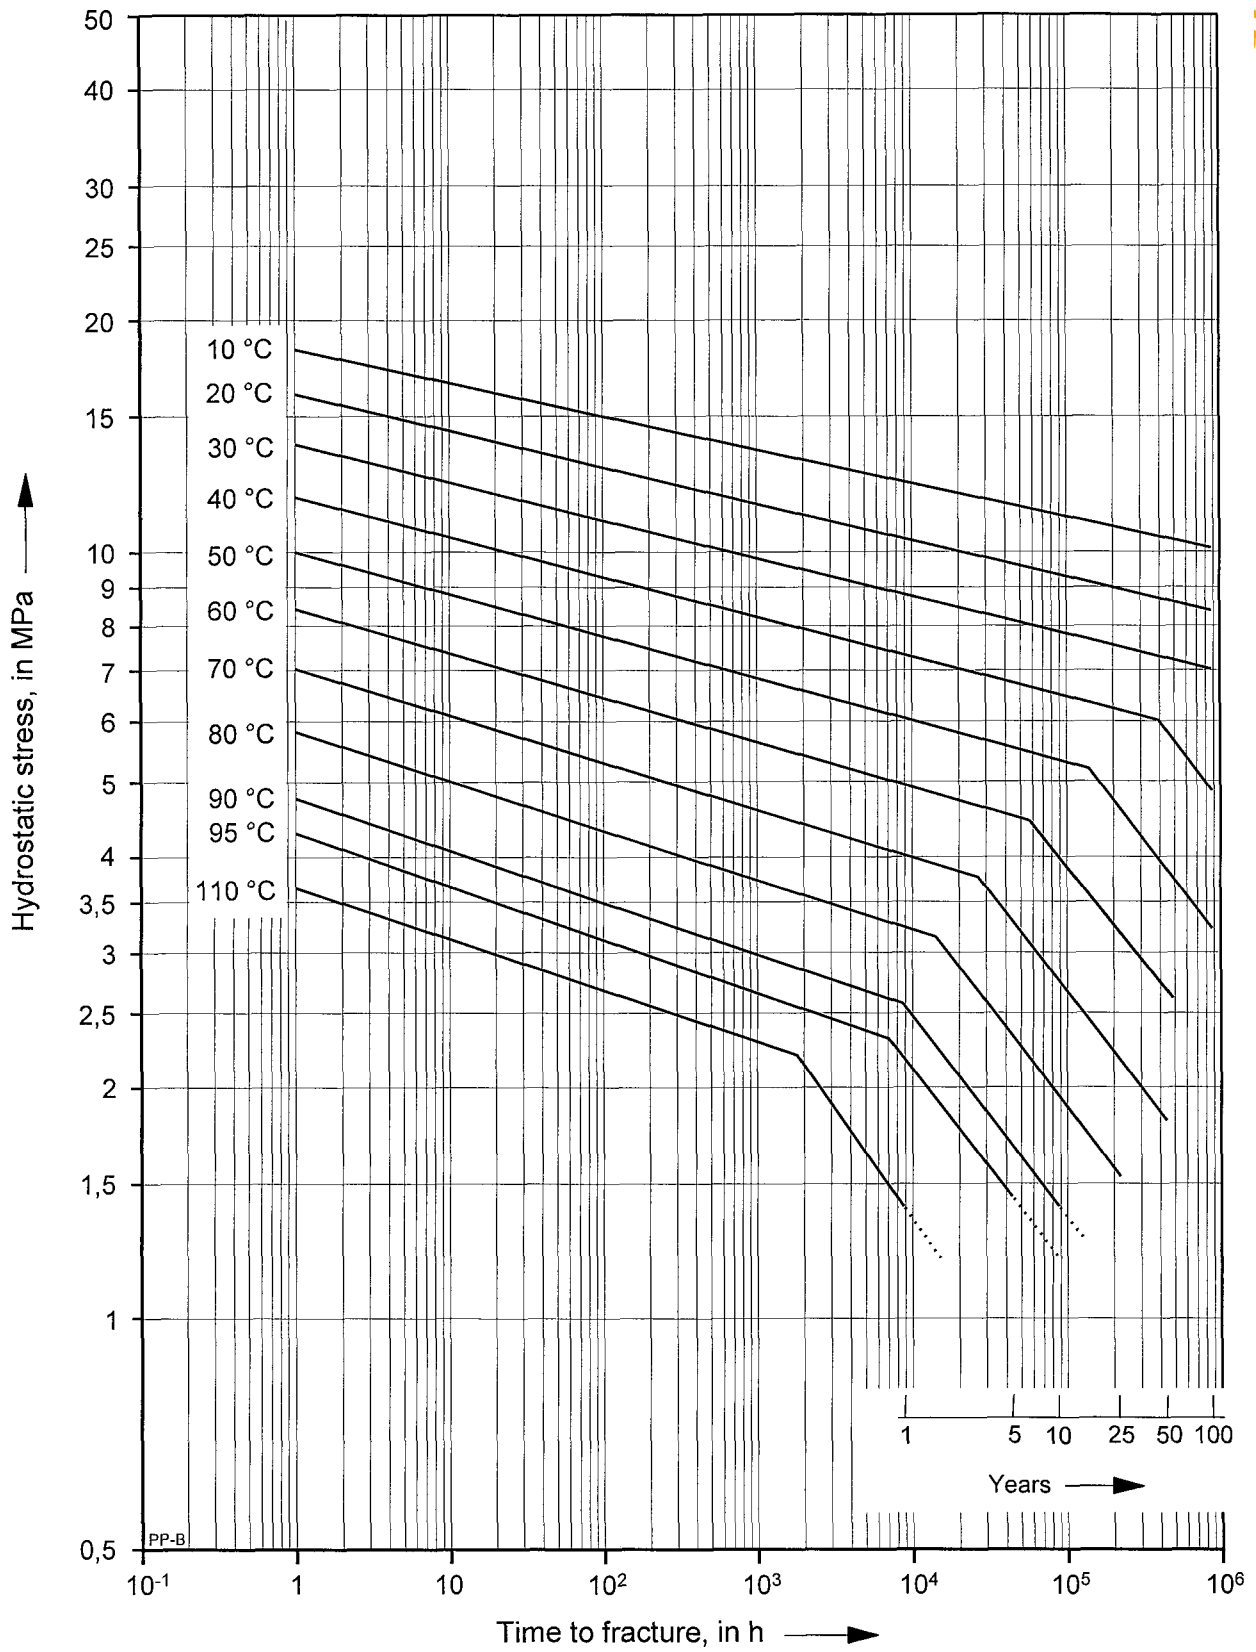


Figure 2 — Reference curves for expected strength of polypropylene block copolymer

Draft

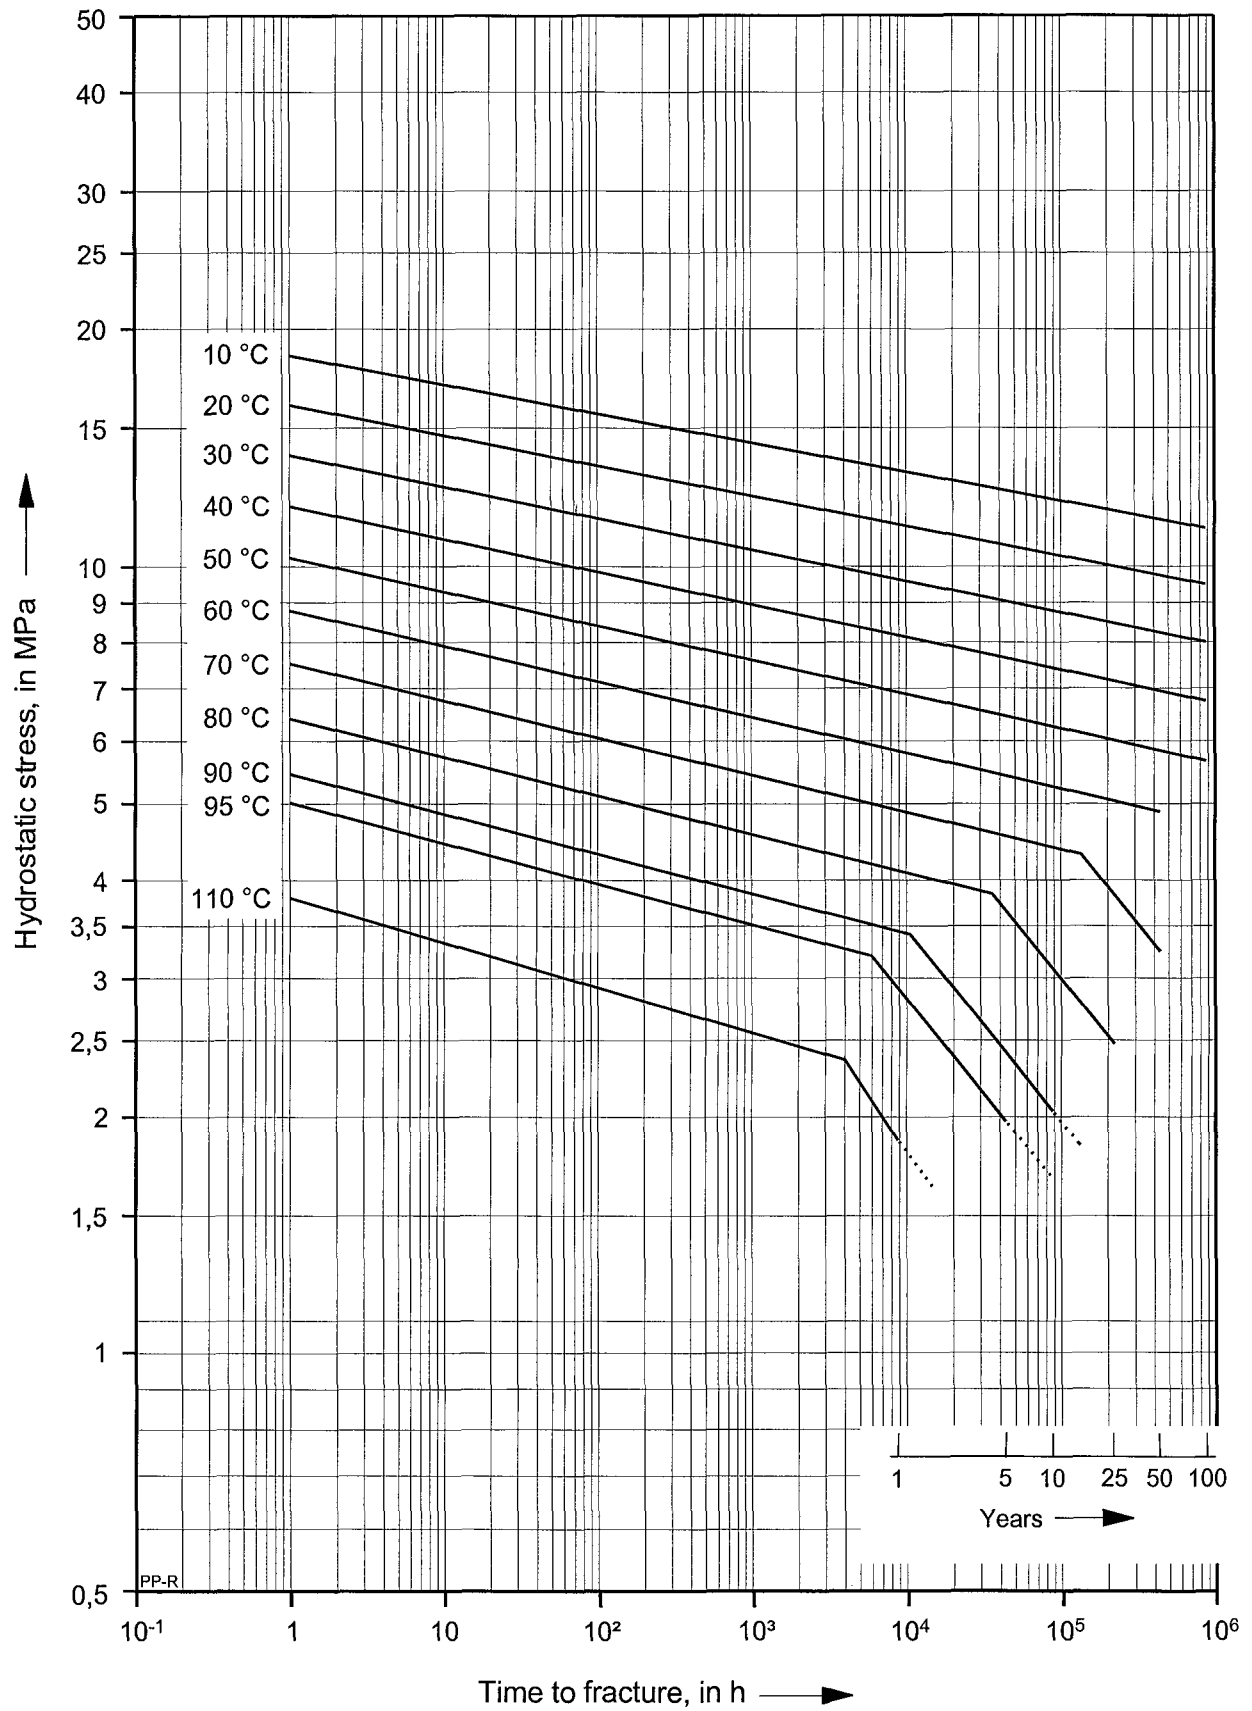


Figure 3 — Reference curves for expected strength of polypropylene random copolymer

4.3 Influence on water intended for human consumption

The material shall conform to EN ISO 15874-1:2003.

5 General characteristics

5.1 Appearance

When viewed without magnification the internal and external surfaces of pipes shall be smooth, clean and free from scoring, cavities, and other surface defects to an extent that would prevent conformity to this standard. The material shall not contain visible impurities. Slight variations in appearance of the colour are permitted. The ends of the pipe shall be cut cleanly and square to the axis of the pipe.

5.2 Opacity

Polypropylene pipes that are declared to be opaque shall not transmit more than 0,2 % of visible light, when tested in accordance with EN 578.

6 Geometrical characteristics

6.1 General

6.1.1 Dimensions shall be measured in accordance with EN ISO 3126.

6.1.2 The maximum calculated pipe value of $S_{calc,max}$ for the applicable class of service conditions and design pressure, p_D , is given in Table 1, 2 or 3.

Table 1 — $S_{calc,max}$ -values for PP-H

p_D	Application			
	Class 1	Class 2	Class 4	Class 5
bar ^a	$S_{calc,max}$ -values ^b			
4	6,3	5,0	6,3	4,6
6	4,8	3,3	5,4	3,0
8	3,6	2,5	4,1	2,3
10	2,9	2,0	3,2	1,8
^a 1 bar = 10 ⁵ N/mm ² . ^b The values are rounded to the first place of decimals.				

Table 2 — $S_{calc,max}$ -values for PP-B

p_D	Application			
	Class 1	Class 2	Class 4	Class 5
bar	$S_{calc,max}$ -values ^a			
4	4,2	3,0	4,9	3,0
6	2,8	2,0	3,3	2,0
8	2,1	1,5	2,4	1,5
10	1,7	1,2	2,0	1,2
^a The values are rounded to the first place of decimals.				

Table 3 — $S_{\text{calc,max}}$ -values for PP-R

p_D	Application			
	Class 1	Class 2	Class 4	Class 5
bar	$S_{\text{calc,max}}$ -values ^a			
4	6,9	5,3	6,9	4,8
6	5,2	3,6	5,5	3,2
8	3,9	2,7	4,1	2,4
10	3,1	2,1	3,3	1,9

^a The values are rounded to the first place of decimals.

NOTE The derivation of $S_{\text{calc,max}}$ is provided in annex A. The method described takes account of the properties of PP under the service conditions of different classes given in Table 1 of EN ISO 15874-1:2003.

6.1.3 The values of outside diameter and/or wall thickness apply to the polypropylene pipe and are exclusive of any barrier layer thickness.

6.1.4 Pipes with non-circular cross section are permitted if they conform to the requirements of this standard.

6.2 Dimensions of pipes

6.2.1 Outside diameters

For the applicable pipe dimension class, the mean outside diameter, d_{em} , of a pipe shall conform to Table 4, 5, 6 or 7, as applicable.

6.2.2 Wall thicknesses and their tolerances

For any particular class of service conditions, design pressure and nominal size, the minimum wall thickness, e_{min} , shall be chosen in such a way that the corresponding S series or S_{calc} -value is equal to or less than the values of $S_{\text{calc,max}}$ given in Table 1, 2 or 3.

For the applicable pipe dimension class, the wall thicknesses, e_{min} and e_n respectively, shall conform to Table 4, 5, 6 or 7, as applicable, in relation to the pipe series S and S_{calc} -values, respectively. However, pipes intended to be joined together by fusion shall have a minimum wall thickness of 2,0 mm.

The tolerance on the wall thickness, e , shall conform to Table 8.

Table 4 — Pipe dimensions for dimension class A
(sizes conform to ISO 4065:1996 [2] and are applicable for all classes of service conditions)

Dimensions in millimetres

Nominal size DN/OD	Nominal outside diameter d_n	Mean outside diameter $d_{em,min}$ $d_{em,max}$		Pipe series			
				S 5	S 3,2	S 2,5	S 2
				Wall thicknesses e_{min} and e_n			
12	12	12,0	12,3	1,8 ^a	1,8	2,0	2,4
16	16	16,0	16,3	1,8	2,2	2,7	3,3
20	20	20,0	20,3	1,9	2,8	3,4	4,1
25	25	25,0	25,3	2,3	3,5	4,2	5,1
32	32	32,0	32,3	2,9	4,4	5,4	6,5
40	40	40,0	40,4	3,7	5,5	6,7	8,1
50	50	50,0	50,5	4,6	6,9	8,3	10,1
63	63	63,0	63,6	5,8	8,6	10,5	12,7
75	75	75,0	75,7	6,8	10,3	12,5	15,1
90	90	90,0	90,9	8,2	12,3	15,0	18,1
110	110	110,0	111,0	10,0	15,1	18,3	22,1
125	125	125,0	126,2	11,4	17,1	20,8	25,1
140	140	140,0	141,3	12,7	19,2	23,3	28,1
160	160	160,0	161,5	14,6	21,9	26,6	32,1

^a A non-preferred wall thickness of 1,1 mm is permitted for $d_n = 12$.

Table 5 — Pipe dimensions for dimension class B1
(sizes based on copper pipe sizes for all classes of service conditions)

Dimensions in millimetres

Nominal size DN/OD	Nominal outside diameter d_n	Mean outside diameter $d_{em,min}$ $D_{em,max}$		Pipe series			
				S 5	S 3,2	S 2,5	S 2
				Wall thicknesses e_{min} and e_n			
10	10	9,9	10,2	1,8	1,8	1,8	2
12	12	11,9	12,2	1,8	1,8	2	2,4
15	15	14,9	15,2	1,8	2	2,5	3
18	18	17,9	18,2	1,8	2,4	3	3,6
22	22	21,9	22,2	2	3	3,7	4,4
28	28	27,9	28,2	2,5	3,8	4,7	5,6
35	35	34,9	35,4	3,2	4,8	5,8	7

Table 6 — Pipe dimensions for dimension class B2
(sizes based on copper pipe sizes for all classes of service conditions)

Dimensions in millimetres

Nominal size DN/OD	Nominal outside diameter d_n	Mean outside diameter		Wall thicknesses e_{\min} and e_n	S_{calc}
		$d_{\text{em,min}}$	$d_{\text{em,max}}$		
14,7	14,7	14,63	14,74	1,6	4,1
21	21	20,98	21,09	2,05	4,6
27,4	27,4	27,33	27,44	2,6	4,8
34	34	34,08	34,19	3,15	4,9

Table 7 — Pipe dimensions for dimension class C
(non-preferred pipe sizes used for example for heating systems.)

Dimensions in millimetres

Nominal size DN/OD	Nominal outside diameter d_n	Mean outside diameter		Wall thicknesses e_{\min} and e_n	S_{calc}
		$d_{\text{em,min}}$	$d_{\text{em,max}}$		
14	14	14,0	14,3	2,0	3,0
15	15	15,0	15,3	2,0	3,2
16	16	16,0	16,3	2,0	3,5
17	17	17,0	17,3	2,0	3,8
18	18	18,0	18,3	2,0	4,0
20	20	20,0	20,3	2,0	4,5

Table 8 — Tolerance on wall thicknesses

Dimensions in millimetres

Minimum wall thickness		Tolerance ^a	Minimum wall thickness		Tolerance ^a
e_{\min}		X	e_{\min}		X
$>$	\leq		$>$	\leq	
1,0	2,0	0,3	11,0	12,0	1,3
2,0	3,0	0,4	12,0	13,0	1,4
3,0	4,0	0,5	13,0	14,0	1,5
4,0	5,0	0,6	14,0	15,0	1,6
5,0	6,0	0,7	15,0	16,0	1,7
6,0	7,0	0,8	16,0	17,0	1,8
7,0	8,0	0,9	17,0	18,0	1,9
8,0	9,0	1,0	18,0	19,0	2,0
9,0	10,0	1,1	19,0	20,0	2,1
10,0	11,0	1,2	20,0	21,0	2,2
			21,0	22,0	2,3

^a The tolerance is expressed in the form $^{+x}_0$ mm, where "x" is the value of the tolerance given.

The level of the tolerances conforms to Grade V in ISO 11922-1:1997 [3].

7 Mechanical characteristics

When tested in accordance with the test methods as specified in Table 9 using the indicated parameters, the pipe shall withstand the hydrostatic (hoop) stress without bursting. In the case of pipes with (a) barrier layer(s) the test shall be carried out on test pieces produced without the barrier layer(s).

Table 9 — Mechanical characteristics of pipes

Characteristic	Requirement	Test parameters for the individual tests				Test method
Resistance to internal pressure	No failure during the test period	PP-H				EN 921:1994
		Hydrostatic (hoop) stress MPa	Test temp. °C	Test period h	Number of test pieces	
		21,0	20	1	3	
		5,1	95	22	3	
		4,2	95	165	3	
		3,5	95	1000	3	
		PP-B				
		Hydrostatic (hoop) stress MPa	Test temp. °C	Test period h	Number of test pieces	
		16,0	20	1	3	
		3,5	95	22	3	
		3,0	95	165	3	
		2,6	95	1000	3	
		PP-R				
		Hydrostatic (hoop) stress MPa	Test temp. °C	Test period h	Number of test pieces	
		16,0	20	1	3	
		4,3	95	22	3	
		3,8	95	165	3	
		3,5	95	1000	3	
		Test parameters for all tests				
		Sampling procedure		a		
Type of end cap		Type a)				
Orientation of test piece		Not specified				
Type of test		Water-in-water				
<p>^a The sampling procedure is not specified. For guidance see CEN ISO/TS 15874-7 [4].</p>						

8 Physical and chemical characteristics

When tested in accordance with the test methods as specified in Table 10 using the indicated parameters, the pipe shall conform to the requirements given in this table.

Table 10 — Physical and chemical characteristics of pipes

Characteristic	Requirement	Test parameters		Test method
		Parameter	Value	
Longitudinal reversion	≤ 2 %	Test temperature PP-H PP-B PP-R Duration of exposure for: $e_n \leq 8$ mm $8 \text{ mm} < e_n \leq 16$ mm $e_n > 16$ mm Number of test pieces	150 °C 150 °C 135 °C 1 h 2 h 4 h 3	Method B of EN 743:1994 (oven test)
Thermal stability by hydrostatic pressure testing	No bursting during the test period	Sampling procedure Hydrostatic (hoop) stress PP-H PP-B PP-R Test temperature Type of test End cap Orientation Test period Number of test pieces	a 1,9 MPa 1,4 MPa 1,9 MPa 110 °C Water-in-air Type a) Not specified 8760 h 1	EN 921:1994
Impact resistance	< 10 %	Sampling procedure Test temperature PP-H PP-B PP-R Number of test pieces	1) 23 °C 0 °C 0 °C 10	ISO 9854
Melt flow rate (compound)	≤ 0,5 g/10 min	Test temperature Mass Number of test pieces	230 °C 2,16 kg 3	ISO 1133
Melt flow rate (pipe)	30 % maximum difference compared with compound	Test temperature Mass Number of test pieces	230 °C 2,16 kg 3	ISO 1133
a The sampling procedure is not specified. For guidance see CEN ISO/TS 15874-7 [4].				

9 Performance requirements

When pipes conforming to this standard are jointed to each other or to components conforming to EN ISO 15874-3 [5], the pipes and the joints shall conform to EN ISO 15874-5.

10 Marking

10.1 General requirements

10.1.1 Marking details shall be printed or formed directly on the pipe not less than once per metre in such a way that after storage, handling, and the installation, (e.g. in accordance with ENV 12108 [1]) legibility is maintained.

NOTE The manufacturer is not responsible for marking being illegible, due to actions such as painting, scratching, covering of the components or by use of detergent etc. on the components unless agreed or specified by the manufacturer.

10.1.2 Marking shall not initiate cracks or other types of defects which adversely influence the performance of the pipe.

10.1.3 If printing is used, the colouring of the printed information shall differ from the basic colouring of the pipe.

10.1.4 The size of the marking shall be such that the marking is legible without magnification.

10.2 Minimum required marking

The minimum required marking of the pipe is specified in Table 11.

Table 11 — Minimum required marking

Aspects	Marking or symbol
- Number of this standard	EN 15874
- Manufacturer's name and/or trade mark	Name or code
- Nominal outside diameter and nominal wall thickness	e.g. 16 × 2,2
- Pipe dimension class	e.g. A
- Material	e.g. PP-R
- Application class combined with operating pressure	e.g. Class 1/10 bar
- Opacity ^a	e.g. opaque
- Manufacturer's information	b
^a If declared by the manufacturer. ^b For proving traceability the following details shall be given: a) the production period, year and month, in figures or in code; b) a name or code for the production site if the manufacturer is producing at different sites.	

NOTE Attention is drawn to the possible need to include CE marking when required for legislative purposes.

Annex A (informative)

Derivation of $S_{\text{calc,max}}$

A.1 General

This annex details the principles regarding the calculation of $S_{\text{calc,max}}$ -values and, hence, of minimum wall thicknesses, e_{min} , of pipes relative to the classes of service conditions (application class) given in Table 1 of EN ISO 15874-1:2003 and the applicable design pressure, p_D .

A.2 Design stress

The design stress, σ_D , for a particular class of service conditions (application class) is calculated from equation (1), (2) or (3) and equation (4), (5) or (6) (see Note 2 of 4.2) using Miner's rule in accordance with EN ISO 13760^[6] and taking into account the applicable class requirements given in EN ISO 15874-1:2003, Table 1 and the service coefficients given in Table A.1.

Table A.1 — Overall service (design) coefficients

Temperature °C	Overall service (design) coefficient C		
	PP-H	PP-B	PP-R
T_{operD}	1,5	1,5	1,5
$T_{\text{max.}}$	1,3	1,3	1,3
T_{mal}	1,0	1,0	1,0
T_{cold}	1,6	1,4	1,4

The resulting design stress, σ_D , has been calculated relative to each class and is given in Table A.2.

Table A.2 — Design stress

Application class	Design stress ^a σ_D MPa		
	PP-H	PP-B	PP-R
1	2,90	1,67	3,09
2	1,99	1,19	2,13
4	3,24	1,95	3,30
5	1,83	1,19	1,90
20 °C/50 years:	6,25	6,21	6,93

^a Values given are rounded to the second place of decimals (i.e. the nearest 0,01 MPa).

A.3 Derivation of maximum value of S_{calc} ($S_{calc,max}$)

$S_{calc,max}$ is the smaller value of

either $\frac{\sigma_{DP}}{p_D}$

where:

σ_{DP} is the design stress in the pipe material taken from Table A.2 in megapascals (MPa);

p_D is the design pressure of 4 bar or 6 bar or 8 bar or 10 bar, as applicable, expressed in megapascals (MPa);

or $\frac{\sigma_{cold}}{p_D}$

where:

σ_{cold} is the design stress at 20 °C relative to a service life of 50 years;

p_D is the design pressure of 10 bar, expressed in megapascals (MPa).

The values of $S_{calc,max}$, relative to each class of service condition (see EN ISO 15874-1:2003) are given in Tables A.3, A.4 and A.5.

Table A.3 — $S_{calc,max}$ values for PP-H

p_D	Application			
	Class 1	Class 2	Class 4	Class 5
Bar	$S_{calc,max}$ -values ^a			
4	6,3 ²⁾	5,0	6,3 ^b	4,6
6	4,8	3,3	5,4	3,0
8	3,6	2,5	4,1	2,3
10	2,9	2,0	3,2	1,8
^a The values are rounded to the first place of decimals. ^b Based on $\sigma_{cold} \cdot p_D$.				

Table A.4 — $S_{calc,max}$ -values for PP-B

p_D	Application			
	Class 1	Class 2	Class 4	Class 5
bar	$S_{calc,max}$ -values ^a			
4	4,2	3,0	4,9	3,0
6	2,8	2,0	3,3	2,0
8	2,1	1,5	2,4	1,5
10	1,7	1,2	2,0	1,2
^a The values are rounded to the first place of decimals.				

Table A.5 — $S_{\text{calc,max}}$ -values for PP-R

p_D	Application			
	Class 1	Class 2	Class 4	Class 5
bar	$S_{\text{calc,max}}$ -values ^a			
4	6,9 ²⁾	5,3	6,9 ^b	4,8
6	5,2	3,6	5,5	3,2
8	3,9	2,7	4,1	2,4
10	3,1	2,1	3,3	1,9
^a	The values are rounded to the first place of decimals.			
^b	Based on $\sigma_{\text{cold}} \cdot p_D$.			

A.4 Use of $S_{\text{calc,max}}$ to determine wall thickness

The S series and S_{calc} values shall be chosen for each application class and design pressure from Table 4, 5, 6 or 7, as applicable, in such a way that S or S_{calc} is not greater than $S_{\text{calc,max}}$ in Table A.3, A.4 or A.5 (see also 6.2).

Bibliography

- [1] ENV 12108, *Plastics piping systems — Guidance for the installation inside buildings of pressure piping systems for hot and cold water intended for human consumption*
- [2] ISO 4065:1996, *Thermoplastics pipes – Universal wall thickness table*
- [3] ISO 11922-1:1997, *Thermoplastics pipes for the conveyance of fluids — Dimensions and tolerances — Part 1: Metric series*
- [4] CEN ISO/TS 15874-7, *Plastics piping systems for hot and cold water installations — Polypropylene (PP) — Part 7: Guidance for the assessment of conformity*
- [5] EN ISO 15874-3, *Plastics piping systems for hot and cold water installations — Polypropylene (PP) — Part 3: Fittings (ISO 15874-3:2003)*
- [6] EN ISO 13760, *Plastics pipes for the conveyance of fluids under pressure — Miner's rule — Calculation method for cumulative damage (ISO 13760:1998)*

Draft for comments only — Not to be cited as East African Standard

Draft for comments only — Not to be cited as East African Standard

ICS 83.140.30; 91.140.60

Price based on 16 pages

Draft for comments only — Not to be cited as East African Standard