



EAST AFRICAN STANDARD

Plastics pipes and fittings — Dimensions of sockets and spigots for discharge systems inside buildings — Part 3: Polypropylene (PP)

EAST AFRICAN COMMUNITY

Foreword

Development of the East African Standards has been necessitated by the need for harmonizing requirements governing quality of products and services in East Africa. It is envisaged that through harmonized standardization, trade barriers which are encountered when goods and services are exchanged within the Community will be removed.

In order to meet the above objectives, the EAC Partner States have enacted an East African Standardization, Quality Assurance, Metrology and Test Act, 2006 (EAC SQMT Act, 2006) to make provisions for ensuring standardization, quality assurance, metrology and testing of products produced or originating in a third country and traded in the Community in order to facilitate industrial development and trade as well as helping to protect the health and safety of society and the environment in the Community.

East African Standards are formulated in accordance with the procedures established by the East African Standards Committee. The East African Standards Committee is established under the provisions of Article 4 of the EAC SQMT Act, 2006. The Committee is composed of representatives of the National Standards Bodies in Partner States, together with the representatives from the private sectors and consumer organizations. Draft East African Standards are circulated to stakeholders through the National Standards Bodies in the Partner States. The comments received are discussed and incorporated before finalization of standards, in accordance with the procedures of the Community.

Article 15(1) of the EAC SQMT Act, 2006 provides that "Within six months of the declaration of an East African Standard, the Partner States shall adopt, without deviation from the approved text of the standard, the East African Standard as a national standard and withdraw any existing national standard with similar scope and purpose".

East African Standards are subject to review, to keep pace with technological advances. Users of the East African Standards are therefore expected to ensure that they always have the latest versions of the standards they are implementing.

© East African Community 2010 — All rights reserved*

East African Community

P O Box 1096

Arusha

Tanzania

Tel: 255 27 2504253/8

Fax: 255-27-2504481/2504255

E-Mail: eac@eachq.org

Web: www.each.int

* © 2010 EAC — All rights of exploitation in any form and by any means reserved worldwide for EAC Partner States' NSBs.

Introduction

In the preparation of this East African Standard, the following source was consulted extensively:

ISO 8283-3:1992], *Plastics pipes and fittings — Dimensions of sockets and spigots for discharge systems inside buildings — Part 3: Polypropylene (PP)*

Assistance derived from this source and others inadvertently not mentioned is hereby acknowledged.

Draft for comments only — Not to be cited as East African Standard

INTERNATIONAL STANDARD

ISO
8283-3

First edition
1992-12-01

Plastics pipes and fittings — Dimensions of sockets and spigots for discharge systems inside buildings —

Part 3: Polypropylene (PP)

*Tubes et raccords en matières plastiques — Dimensions des emboîtures
et des bouts mâles pour raccordement de tubes et raccords dans les
systèmes d'évacuation à l'intérieur des bâtiments —*

Partie 3: Polypropylène (PP)



Reference number
ISO 8283-3:1992(E)

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

International Standard ISO 8283-3 was prepared by Technical Committee ISO/TC 138, *Plastics pipes, fittings and valves for the transport of fluids*, Sub-Committee SC 1, *Plastics pipes and fittings for soil, waste and drainage (including land drainage)*.

ISO 8283 consists of the following parts, under the general title *Plastics pipes and fittings — Dimensions of sockets and spigots for discharge systems inside buildings*:

- *Part 1: Unplasticized poly(vinyl chloride) (PVC-U) and chlorinated poly(vinyl chloride) (PVC-C)*
- *Part 2: Polyethylene (PE)*
- *Part 3: Polypropylene (PP)*
- *Part 4: Acrylonitrile/butadiene/styrene (ABS)*

Annex A forms an integral part of this part of ISO 8283.

© ISO 1992

All rights reserved. No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from the publisher.

International Organization for Standardization
Case Postale 56 • CH-1211 Genève 20 • Switzerland

Printed in Switzerland

Introduction

The socket design appropriate for a particular application should be chosen according to the type of system and jointing techniques to be used. Various socket designs are specified in this part of ISO 8283. They may be selected for use in accordance with the requirements of relevant national standards and codes of practice, which give information on the choice of the type of system and jointing techniques to be used.

This page intentionally left blank

Plastics pipes and fittings — Dimensions of sockets and spigots for discharge systems inside buildings —

Part 3:

Polypropylene (PP)

1 Scope

This part of ISO 8283 specifies the design formulae and the derived dimensions, together with tolerances, of sockets and spigots for joints of polypropylene (PP) fittings and for integral sockets of PP pipes used in discharge systems inside buildings where such joints are intended to accommodate expansion and contraction in the discharge system.

NOTE 1 Polypropylene means plastics based on polymers of propylene or copolymers of propylene with other monomers, the propylene being in the greatest amount by mass. (Definition based on that given in ISO 472:1988, *Plastics — Vocabulary*.)

2 Ring-seal sockets and spigots

2.1 General

These sockets can accommodate expansion and contraction in a discharge system.

2.2 Ring-seal grooves

A selection of typical ring-seal groove designs is shown in figure 1, and the positions of measurement of specified dimensions are indicated. The design of the groove is not restricted to those illustrated.


2.3 Seal-ring retaining components

Seal-ring retaining components may be manufactured from plastics materials other than PP.

2.4 Dimensions

When measured in accordance with figure 1, the dimensions of ring-seal sockets and related spigots shall comply with the applicable limits given in table 1.

There shall be no requirement on dimension *B* where the seal-ring is firmly retained in the groove.

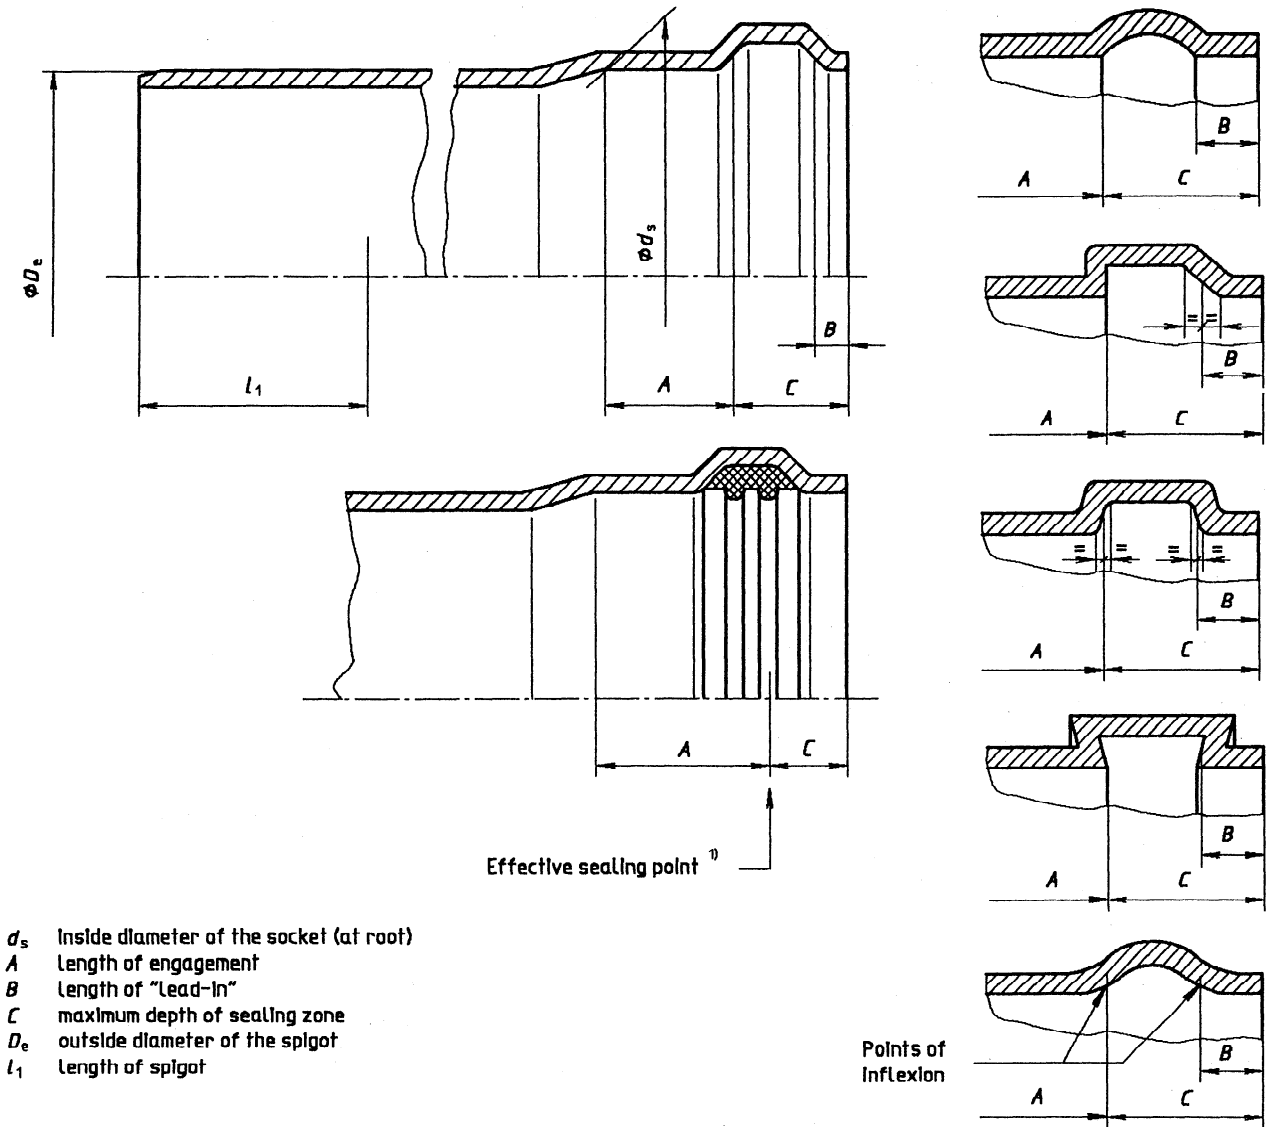

1) When a sealing ring with more than one sealing point is used, the points of measurement for A and C shall be indicated by the manufacturer and these points shall give a full sealing action.

Figure 1 — Location of points of measurement for sockets and spigots

Table 1 — Dimensions of ring-seal sockets and related spigots

Dimensions in millimetres

Nominal outside diameter <i>D</i>	<i>D_e</i>		<i>d_s</i>	<i>A</i>	<i>B</i>	<i>C</i>	<i>l₁</i>
	min.	max.	min.	min.	min.	max.	min.
32	32,0	32,3	32,3	24	5	18	42
40	40,0	40,3	40,3	26	5	18	44
50	50,0	50,3	50,3	28	5	18	46
63	63,0	63,3	63,3	31	5	18	49
75	75,0	75,3	75,3	33	5	18	51
90	90,0	90,3	90,3	34	5	20	54
110	110,0	110,4	110,4	36	6	22	58
125	125,0	125,4	125,4	38	7	26	64
160	160,0	160,5	160,5	41	9	32	73
200	200,0	200,6	200,6	45	12	40	85

NOTE — This table specifies the permitted limits, calculated using the relationships given in annex A, on the main dimensions indicated in figure 1, together with non-calculated limits on the other dimensions. The calculated values have been rounded up to the nearest 0,1 mm for diameters and rounded to the nearest 1 mm for other dimensions. The value given for the length of engagement *A* in table 1 relates to a pipe length of 3 m inside buildings above ground.

The nominal outside diameters have been selected from ISO 161-1:1978, *Thermoplastics pipes for the transport of fluids — Nominal outside diameters and nominal pressures — Part 1: Metric series.*

Annex A
(normative)

Ring-seal design calculations

Table A.1 — Relationships for the calculation of the dimensions of ring-seal sockets and related dimensions

Dimensions in millimetres

Nominal outside diameter <i>D</i>	<i>D_e</i>		<i>d_s</i> min.	<i>A</i> min.	<i>l₁</i> min.
	min.	max.			
32	32,0	$D_{e,min} + 0,3$	$D_{e,max}$	$0,2D_{e,min} + 18$	$C_{max} + A_{min}$
40	40,0				
50	50,0				
63	63,0				
75	75,0				
90	90,0	$1,003D_{e,min}$		$0,1D_{e,min} + 25$	
110	110,0				
125	125,0				
160	160,0				
200	200,0				

This page intentionally left blank

This page intentionally left blank

This page intentionally left blank

UDC 621.643.413-036.742.3:696.122

Descriptors: buildings, drainage, plastics products, polypropylene, plastic tubes, pipe fittings, spigot-and-socket joints, pipe sockets, dimensions.

Price based on 4 pages

Draft for comments only — Not to be cited as East African Standard