



CD/K/168:2009
ICS 91.140.60; 23.040.45

EAST AFRICAN STANDARD

Steel mesh reinforced polyethylene (PE) pipe fittings for water supply — Specification

Draft for comments only — Not to be cited as East African Standard

EAST AFRICAN COMMUNITY

Foreword

Development of the East African Standards has been necessitated by the need for harmonizing requirements governing quality of products and services in East Africa. It is envisaged that through harmonized standardization, trade barriers which are encountered when goods and services are exchanged within the Community will be removed.

In order to meet the above objectives, the EAC Partner States have enacted an East African Standardization, Quality Assurance, Metrology and Test Act, 2006 (EAC SQMT Act, 2006) to make provisions for ensuring standardization, quality assurance, metrology and testing of products produced or originating in a third country and traded in the Community in order to facilitate industrial development and trade as well as helping to protect the health and safety of society and the environment in the Community.

East African Standards are formulated in accordance with the procedures established by the East African Standards Committee. The East African Standards Committee is established under the provisions of Article 4 of the EAC SQMT Act, 2006. The Committee is composed of representatives of the National Standards Bodies in Partner States, together with the representatives from the private sectors and consumer organizations. Draft East African Standards are circulated to stakeholders through the National Standards Bodies in the Partner States. The comments received are discussed and incorporated before finalization of standards, in accordance with the procedures of the Community.

Article 15(1) of the EAC SQMT Act, 2006 provides that "Within six months of the declaration of an East African Standard, the Partner States shall adopt, without deviation from the approved text of the standard, the East African Standard as a national standard and withdraw any existing national standard with similar scope and purpose".

East African Standards are subject to review, to keep pace with technological advances. Users of the East African Standards are therefore expected to ensure that they always have the latest versions of the standards they are implementing.

© East African Community 2010 — All rights reserved*

East African Community

P O Box 1096

Arusha

Tanzania

Tel: 255 27 2504253/8

Fax: 255-27-2504481/2504255

E-Mail: eac@eachq.org

Web: www.each.int

* © 2010 EAC — All rights of exploitation in any form and by any means reserved worldwide for EAC Partner States' NSBs.

Introduction

In the preparation of this East African Standard, the following source was consulted extensively:

SANS 371:2009, *Steel mesh reinforced polyethylene (PE) pipe fittings for water supply — Specification*

Assistance derived from this source and others inadvertently not mentioned is hereby acknowledged.

Draft for comments only — Not to be cited as East African Standard

This standard may only be used and printed by approved subscription and freemailing clients of the SABS.

ISBN 978-0-626-22538-4

SANS 371:2009

Edition 1.1

SOUTH AFRICAN NATIONAL STANDARD

Steel mesh reinforced polyethylene (PE) pipe fittings for water supply

Published by SABS Standards Division
1 Dr Lategan Road Groenkloof ☒ Private Bag X191 Pretoria 0001
Tel: +27 12 428 7911 Fax: +27 12 344 1568
www.sabs.co.za
© SABS

SABS

SANS 371:2009

Edition 1.1

Table of changes

Change No.	Date	Scope
Amdt 1	2009	Amended to update referenced standards, to insert the definition of "acceptable" and to re-number the definitions accordingly.

Foreword

This South African standard was approved by National Committee SABS SC 138H, *Water and sanitation – Equipment and systems – Plastics pipes and fittings*, in accordance with procedures of the SABS Standards Division, in compliance with annex 3 of the WTO/TBT agreement.

This document was published in November 2009.

This document supersedes SANS 371:2005 (edition 1).

A vertical line in the margins shows where the text has been technically modified by amendment No. 1.

Annex A forms an integral part of this document. Annex B is for information only.

The requirements in 12(a) constitute, in terms of section 27(2) of the Standards Act, 2008 (Act No. 8 of 2008), a self-declaration of conformity by the manufacturer, notwithstanding the implications of third-party certification mark that might also be displayed.

Contents

	Page
Foreword	
1 Scope	3
2 Normative references	3
3 Definitions	4
4 Requirements for materials	5
4.1 Requirements for PE compounds	5
4.1.1 General	5
4.1.2 Dispersion of carbon black	5
4.1.3 Dispersion of blue pigments	5
4.1.4 Thermal stability	6
4.1.5 Effects of materials on water quality	6
4.1.6 Melt flow rate and density	6
4.2 Requirements for steel plates	6
4.2.1 Steel plate	6
4.2.2 Coating	6
5 Requirements for dimensions of fittings	6
5.1 Electrofusion couplers	6
5.2 Reducers	7
5.3 Flange fittings	9
5.4 Tapping saddles	10
5.5 Pipe fittings with coned ends	10
6 Requirements for geometrical characteristics and nominal pressures	15
6.1 Dimensions of the pipe fittings: nominal diameters, wall thicknesses, and nominal pressures	15
6.2 Wall thickness	15
6.3 Ovality	15
7 General requirements	15
7.1 Colour	15
7.2 Appearance	15
7.3 General requirements for electrofusion coupler	16
8 Requirements for pressure reduction factors	16

SANS 371:2009
Edition 1.1

Contents *(concluded)*

	Page
9 Requirements for mechanical characteristics	16
9.1 General	16
9.2 Hydrostatic and decohesive strength	16
10 Requirements for physical characteristics	17
10.1 Thermal stability of pipe fittings manufactured from PE 63 and PE 80	17
10.2 Weathering of non-black pipe fittings	17
11 Packing, transportation and storage	18
12 Marking	19
Annex A (normative) Pressure and structural design of the pipe fittings	20
Annex B (informative) Quality verification of steel mesh reinforced polyethylene (PE) pipe fittings for water supply	23
Bibliography	23

Steel mesh reinforced polyethylene (PE) pipe fittings for water supply

1 Scope

This standard specifies the required properties, classification and geometrical characteristics of steel mesh reinforced polyethylene (PE) pipe fittings made by combining mesh-shaped steel reinforcement with polyethylene through injection moulding technology. The requirements for raw materials, marking, packing, storage and handling of the pipe fittings are also specified. The steel mesh is made by winding and welding perforated steel plate to a tube.

This standard applies to steel mesh reinforced polyethylene (PE) pipe fittings intended to be used for the conveyance of water under pressure, for general purposes, as well as for the supply of drinking water, with temperatures not exceeding 80 °C.

2 Normative references

The following standards contain provisions which, through reference in this text, constitute provisions of this standard. All standards are subject to revision and, since any reference to a standard is deemed to be a reference to the latest edition of that standard, parties to agreements based on this standard are encouraged to take steps to ensure the use of the most recent editions of the standards indicated below. Information on currently valid national and international standards can be obtained from the SABS Standards Division.

2.1 Standards

ISO 6964, *Polyolefin pipes and fittings – Determination of carbon black content by calcination and pyrolysis – Test method and basic specification.*

ISO 8085-3, *Polyethylene fittings for use with polyethylene pipes for the supply of gaseous fuels – Metric series – Specifications – Part 3: Electrofusion fittings.*

ISO 12162, *Thermoplastics materials for pipes and fittings for pressure applications – Classification and designation – Overall service (design) coefficient.*

ISO 13954, *Plastics pipes and fittings – Peel decohesion test for polyethylene (PE) electrofusion assemblies of nominal outside diameter greater than or equal to 90 mm.*

ISO 18553, *Method for the assessment of the degree of pigment or carbon black dispersion in polyolefin pipes, fittings and compounds.*

ISO/TR 10837, *Determination of the thermal stability of polyethylene (PE) for use in gas pipes and fittings.* Amdt 1

SANS 371:2009
Edition 1.1

SANS 241, *Drinking water.*

~~SANS 130/ISO 1167 (SABS ISO 1167), *Thermoplastics pipes for the conveyance of fluids – Resistance to internal pressure – Test method.* Amdt 1~~

SANS 130-1/ISO 1167-1, *Thermoplastics pipes, fittings and assemblies for the conveyance of fluids – Determination of the resistance to internal pressure – Part 1: General method.* Amdt 1

SANS 370, *Steel mesh reinforced polyethylene (PE) pipes for water supply.*

SANS 1133/ISO 1133, *Plastics – Determination of the melt mass-flow rate (MFR) and the melt volume-flow rate (MVR) of thermoplastics.*

SANS 3126/ISO 3126, *Plastics piping systems – Plastics components – Determination of dimensions.*

SANS 9080/ISO 9080, *Plastics piping and ducting systems – Determination of the long-term hydrostatic strength of thermoplastics materials in pipe form by extrapolation.*

SANS 11922-1/ISO 11922-1, *Thermoplastics pipes for the conveyance of fluids – Dimensions and tolerances – Part 1: Metric series.*

2.2 Other publications

Guidelines for drinking water quality – Second edition – Volume 1: Recommendations, WHO, Geneva, 1993.

EC Council Directive 98/83/EC of 3rd November 1988 on the *quality of water intended for human consumption*, Official journal of the European Community, L229, pp.11 to 29.

3 Definitions

For purposes of this standard, the following definitions apply:

3.1 acceptable Amdt 1
acceptable to the authority administering this standard, or to the parties concluding the purchase contract, as relevant

3.2 minimum wall thickness Amdt 1
 $e_{y, \min}$
specified minimum wall thickness at any point around the circumference of the pipe, in millimetres

3.3 nominal inside diameter Amdt 1
 d_n
size designation based on the internal diameter of a pipe common to all components, other than flanges

NOTE The size designation is given as a convenient round number in millimetres.

3.4 nominal pressure Amdt 1
PN
specified maximum allowable operating pressure of the pipe at 20 °C, in bars

SANS 371:2009
Edition 1.1

- 3.5** **nominal wall thickness** Amdt 1 |
 e_n
specified wall thickness, in millimetres, identical with the minimum wall thickness at any point ($e_{y, \min}$)
- 3.6** **ovality of electrofusion coupler** Amdt 1 |
difference between the measured maximum inside diameter and the measured minimum inside diameter in the same cross-section plate of the electrofusion coupler (see 5.1)
- 3.7** **ovality of pipe fittings to be joined with electrofusion coupler** Amdt 1 |
difference between the measured maximum outside diameter and the measured minimum outside diameter in the same cross-section plate of the pipe fitting (see 5.1 and 7.3)
- 3.8** **pipe fitting with coned end** Amdt 1 |
pipe fitting to be joined to other components of a piping system with electrofusion coupler, the coned end of which is injection moulded (see 5.5)
- 3.9** **pressure reduction factors** Amdt 1 |
factors of value smaller than 1, applied to obtain the maximum allowable operating pressure for elevated temperature operation of the pipe fittings specified in this standard
- 3.10** **steel mesh** Amdt 1 |
reinforcement of the pipe fittings specified in this standard, which is made by winding and welding a low carbon steel plate punched with holes to form a continuous tube-like mesh

4 Requirements for materials

4.1 Requirements for PE compounds

4.1.1 General

4.1.1.1 Pipe fittings shall be manufactured from PE compound containing only those antioxidants, UV stabilizers and pigments necessary for the manufacture of fittings conforming to this standard and for its end use. The additives shall be uniformly dispersed.

4.1.1.2 When determined in accordance with ISO 6964, the carbon black content in the compound shall be (2,25 % \pm 0,25 %) by mass.

4.1.1.3 PE 63 and PE 80 resin that are classified in accordance with SANS 9080 and ISO 12162, and are recommended for the manufacture of pipe fittings.

4.1.2 Dispersion of carbon black

When determined in accordance with ISO 18553, the dispersion of the carbon black shall be equal to or less than grade 3.

4.1.3 Dispersion of blue pigments

When determined in accordance with ISO 18553, the dispersion of blue pigments shall be equal to or less than grade 3.

SANS 371:2009

Edition 1.1

4.1.4 Thermal stability

When determined in accordance with an acceptable method, the induction time for materials PE 63 and PE 80 shall be either at least 20 min when tested at 200 °C, or an equivalent period when tested at 210 °C.

Amdt 1

NOTE In case of dispute, a test temperature of 200 °C will be used.

4.1.5 Effects of materials on water quality

When used under conditions for which they are designed, materials in contact with or likely to come into contact with drinking water shall not constitute a toxic hazard, shall not support microbial growth and shall not give rise to unpleasant taste or odour, cloudiness or discoloration of the water.

The concentrations of substances, chemicals and biological agents leached from materials in contact with drinking water, and measurements of the relevant organoleptic/physical parameters, shall not exceed the maximum values recommended by the World Health Organization in its publication *Guidelines for drinking water quality*, Volume 1: *Recommendations*, or as required by the EC Council Directive 98/83/EC of 3 November 1998 on the quality of water intended for human consumption, whichever is the more stringent in each case. SANS 241 may apply as alternative, if users prefer to.

4.1.6 Melt flow rate and density

When measured in accordance with SANS 1133, the melt flow rate (MFR) shall conform to the following conditions:

- a) the melt flow rate of the compound shall not deviate by more than ± 30 % from the value specified by the manufacturer of the raw material;
- b) the change in MFR caused by processing, i.e. the difference between the measured value for material from the pipe fitting and the measured value for the compound, shall not be more than 25 %.

4.2 Requirements for steel plates

4.2.1 Steel plate

The steel reinforcement for pipe fittings production shall be made from normal low carbon steel plate or alloy steel plate with good weldability.

4.2.2 Coating

The steel plate shall be coated with metallic material with excellent corrosion resistance. The coating shall be clean, smooth, overall and free from scaling, dust or grease.

5 Requirements for dimensions of fittings

5.1 Electrofusion couplers

The requirements for electrofusion couplers are given in table 1 and figure 1.

Table 1 — Geometrical characteristics and nominal pressures of electrofusion couplers

1	2	3	4	5
Nominal inside diameter of corresponding pipe, d_n mm	Length of fusion zone, l , \geq mm	L , \geq mm	α	Nominal pressure, PN bar
50	140	194	30'	25
65	140	194	30'	25
80	140	194	30'	25
100	140	194	30'	25
125	140	194	30'	25
150	160	213	30'	20
200	180	232	30'	20
250	200	252	30'	20
300	230	291	30'	20
350	250	310	1°	16
400	270	329	1°	16
450	290	349	1°	16
500	290	368	1°	16

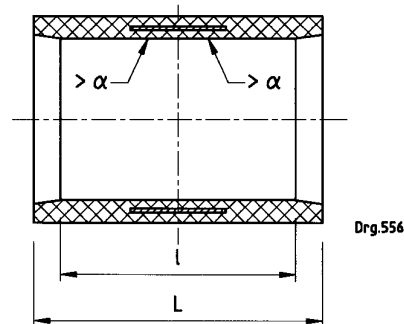


Figure 1 — Electrofusion couplers

5.2 Reducers

The requirements for reducers are given in table 2 and figure 2.

SANS 371:2009
Edition 1.1

Table 2 — Geometrical characteristics and nominal pressures of reducers

1	2	3	4	5	6
Nominal inside diameter, d_1/d_2 mm	External diameter of fusion zone and tolerance, D_1 mm	External diameter of fusion zone and tolerance, D_2 mm	L mm	L_1 mm	Nominal pressure, PN bar
500/450	545 ⁺⁰ _{-1,6}	495 ⁺⁰ _{-1,6}	820	395	16
500/400	545 ⁺⁰ _{-1,6}	440 ⁺⁰ _{-1,6}	820	395	16
450/400	495 ⁺⁰ _{-1,6}	440 ⁺⁰ _{-1,6}	780	375	16
450/350	495 ⁺⁰ _{-1,6}	390 ⁺⁰ _{-1,6}	780	375	16
400/350	440 ⁺⁰ _{-1,6}	390 ⁺⁰ _{-1,6}	740	355	16
400/300	440 ⁺⁰ _{-1,6}	337 ⁺⁰ _{-1,6}	740	355	16
350/300	390 ⁺⁰ _{-1,6}	337 ⁺⁰ _{-1,6}	660	335	16
300/250	337 ⁺⁰ _{-1,6}	287 ⁺⁰ _{-1,6}	610	275	20
300/200	337 ⁺⁰ _{-1,6}	234 ⁺⁰ _{-1,6}	610	275	20
250/200	287 ⁺⁰ _{-1,6}	234 ⁺⁰ _{-1,6}	560	245	20
250/150	287 ⁺⁰ _{-1,6}	182 ⁺⁰ _{-1,6}	560	245	20
200/150	234 ⁺⁰ _{-1,6}	182 ⁺⁰ _{-1,6}	500	225	20
200/100	234 ⁺⁰ _{-1,6}	128 ⁺⁰ _{-1,4}	500	225	20
150/100	182 ⁺⁰ _{-1,6}	128 ⁺⁰ _{-1,4}	470	200	20

NOTE Not all sizes of reducers that conform to this standard are given in this table.

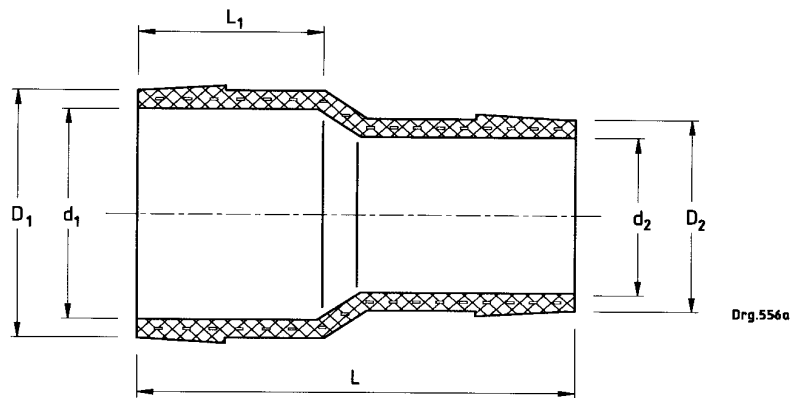


Figure 2 — Reducers

5.3 Flange fittings

The requirements for flange fittings are given in table 3 and figure 3.

Table 3 — Geometrical characteristics and nominal pressures of flange fittings

1	2	3	4	5	6	7
Nominal inside diameter, d_n mm	α	Length of flange fitting, L mm	D mm	D_1 mm	External diameter of fusion zone and tolerance, D_2 mm	Nominal pressure, PN bar
150	30°	220	280	241,5	182 $^{+0}_{-1,6}$	20
200	30°	240	345	298,5	234 $^{+0}_{-1,6}$	20
250	30°	270	405	362,0	287 $^{+0}_{-1,6}$	20
300	30°	300	485	432,0	337 $^{+0}_{-1,6}$	20
350	1°	310	520	470,0	390 $^{+0}_{-1,6}$	16
400	1°	320	580	525,0	440 $^{+0}_{-1,6}$	16
450	1°	330	640	585,0	495 $^{+0}_{-1,6}$	16
500	1°	350	715	650,0	545 $^{+0}_{-1,6}$	16

NOTE Not all sizes of flange fittings that conform to this standard are given in this table.

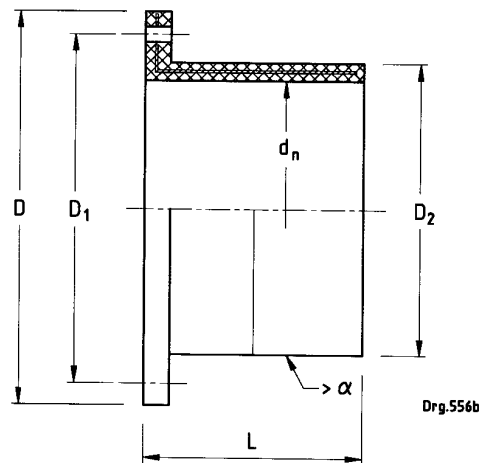


Figure 3 — Flange fittings

SANS 371:2009

Edition 1.1

5.4 Tapping saddles

The requirements for tapping saddles are given in table 4 and figure 4.

Table 4 — Geometrical characteristics and nominal pressures of tapping saddles

1	2	3	4
Nominal inside diameter, d_n mm	L, \geq mm	h, \geq mm	Nominal pressure, PN bar
150	200	120	16
200	200	145	16
250	215	170	16
300	230	195	16

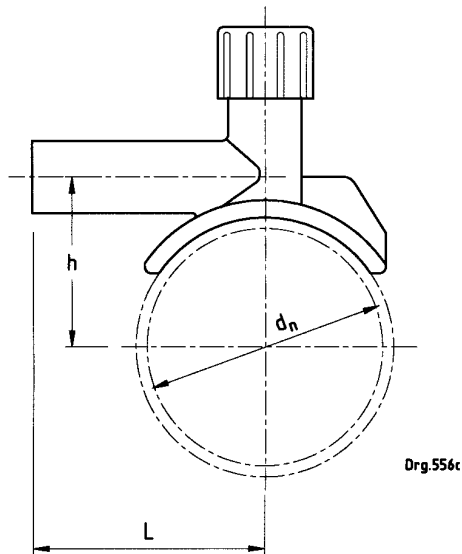


Figure 4 — Tapping saddles

5.5 Pipe fittings with coned ends

Pipe fittings with coned ends include: 45° bends, 90° bends, 22,5° bends, 11,25° bends and tees. The requirements for pipe fittings with flanged ends are given in tables 5, 6 and 7 and figures 5, 6 and 7.

SANS 371:2009
Edition 1.1

Table 5 — Geometrical characteristics and nominal pressures of 90° bends

1	2	3	4	5
Nominal inside diameter, d_n	Nominal wall thickness, e_n	L_1	External diameter of fusion zone and tolerance, D	Nominal pressure, PN
mm	mm	mm	mm	bar
50	12,5	205	$75^{+0}_{-1,1}$	25
65	12,5	215	$90^{+0}_{-1,2}$	25
80	12,5	225	$105^{+0}_{-1,3}$	25
100	14,0	240	$128^{+0}_{-1,4}$	25
125	15,5	255	$156^{+0}_{-1,6}$	25
150	16,0	280	$182^{+0}_{-1,6}$	20
200	17,0	320	$234^{+0}_{-1,6}$	20
250	18,0	360	$287^{+0}_{-1,6}$	20
300	18,0	405	$337^{+0}_{-1,6}$	20

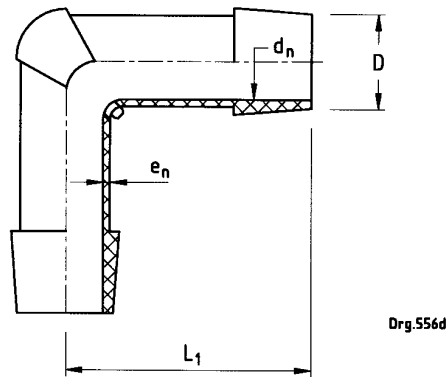


Figure 5 — 90° bend with coned end

SANS 371:2009
Edition 1.1

Table 6 — Geometrical characteristics and nominal pressures of 45° bends

1	2	3	4	5
Nominal inside diameter, d_n mm	Nominal wall thickness, e_n mm	L_1 mm	External diameter of fusion zone and tolerance, D mm	Nominal pressure, PN bar
50	12,5	170	$75^{+0}_{-1,1}$	25
65	12,5	175	$90^{+0}_{-1,2}$	25
80	12,5	180	$105^{+0}_{-1,3}$	25
100	14,0	185	$128^{+0}_{-1,4}$	25
125	15,5	190	$156^{+0}_{-1,6}$	25
150	16,0	210	$182^{+0}_{-1,6}$	25
200	17,0	235	$234^{+0}_{-1,6}$	20
250	18,0	255	$287^{+0}_{-1,6}$	20
300	18,0	285	$337^{+0}_{-1,6}$	20
350	20,0	350	$390^{+0}_{-1,6}$	16
400	20,0	370	$440^{+0}_{-1,6}$	16
450	22,0	390	$495^{+0}_{-1,6}$	16
500	22,0	410	$545^{+0}_{-1,6}$	16

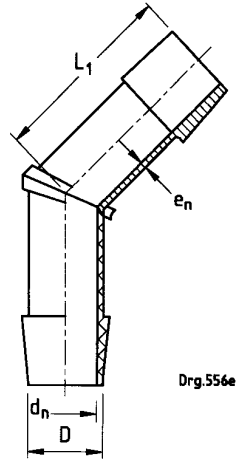


Figure 6 — 45° bend with coned end

Table 7 — Geometrical characteristics and nominal pressures of tees

1	2	3	4	5
Nominal inside diameter, d_n mm	Nominal wall thickness, e_n mm	L_1 mm	External diameter of fusion zone and tolerance, D mm	Nominal pressure, PN bar
50	12,5	390	75 ⁺⁰ -1,1	25
65	12,5	410	90 ⁺⁰ -1,2	25
80	12,5	430	105 ⁺⁰ -1,3	25
100	14,0	460	128 ⁺⁰ -1,4	25
125	15,5	490	156 ⁺⁰ -1,6	25
150	16,0	530	182 ⁺⁰ -1,6	20
200	17,0	610	234 ⁺⁰ -1,6	20
250	18,0	690	287 ⁺⁰ -1,6	20

SANS 371:2009
Edition 1.1

Table 7 (concluded)

1	2	3	4	5
Nominal inside diameter, d_n mm	Nominal wall thickness, e_n mm	L_1 mm	External diameter of fusion zone and tolerance, D mm	Nominal pressure, PN bar
300	18,0	780	$337^{+0}_{-1,6}$	20
350	20,0	900	$390^{+0}_{-1,6}$	16
400	20,0	970	$440^{+0}_{-1,6}$	16
450	22,0	1 050	$495^{+0}_{-1,6}$	16
500	22,0	1 120	$545^{+0}_{-1,6}$	16

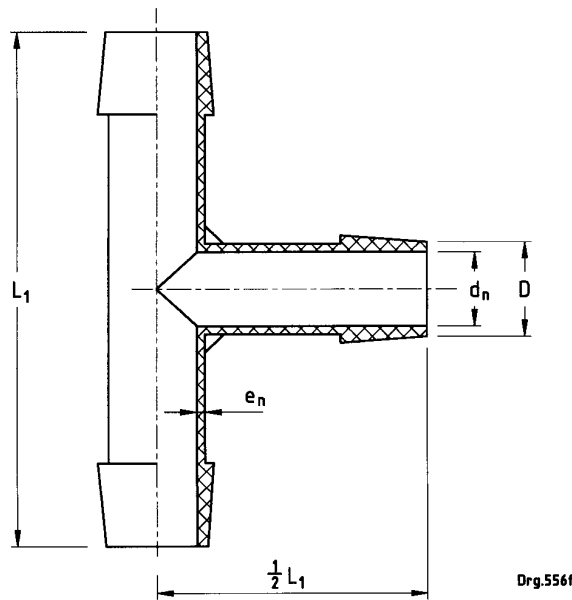


Figure 7 — Tee with coned end

6 Requirements for geometrical characteristics and nominal pressures

6.1 Dimensions of the pipe fittings: nominal diameters, wall thicknesses, and nominal pressures

6.1.1 The requirements of the pipe fittings specified in this standard are consistent with those of pipes specified in SANS 370.

6.1.2 The dimensions of pipe fittings shall be measured in accordance with SANS 3126.

6.1.3 In this standard, the nominal pressures of the pipe fittings are so specified as to facilitate the manufacture and application of the fittings, as given in table 1 to table 7 (inclusive). The nominal pressures of the pipe fittings are consistent with the maximum-class nominal pressures of the pipes specified in SANS 370.

NOTE When the pipe fitting is working under pressure, the load is mainly sustained by the steel plate. The manufacturing cost for pipe fittings of different nominal pressures does not differ much as determined by the structural characteristics of the pipe fittings and mechanical principles.

6.2 Wall thickness

The wall thickness of the pipe fitting at any point shall not be less than that of the corresponding pipe. The tolerance on the wall thickness shall conform to the requirements of SANS 11922-1, grade T.

6.3 Ovality

The maximum and minimum outside diameter or inside diameter of the pipe fitting shall be measured in accordance with SANS 3126. The ovality of the pipe fittings shall conform to SANS 11922-1, as follows:

- a) grade L for electrofusion couplers; and
- b) grade M for other pipe fittings except electrofusion coupler.

7 General requirements

7.1 Colour

The fittings shall be black or blue or black with blue stripes.

NOTE For above ground installations, all blue components and components with non-black layers should be protected from direct UV light.

7.2 Appearance

7.2.1 When viewed without magnification, the internal surface and external surface shall be smooth, clean and free from scoring, discoloration, lines and cracks. The external surface may take on a natural contracting appearance. The pure PE surfaces of the coned end allows slight shrinkage.

7.2.2 The surface of the flange shall be cut smooth, clean and free from defects such as cavities, scoring and burs.

SANS 371:2009

Edition 1.1

7.3 General requirements for electrofusion coupler

The heating wire of the electrofusion coupler shall be tightly located onto the inner surface of the fitting and the connector pins shall be firmly bonded to the fitting body.

Exposure of steel plate is not allowed on either internal surface or external surface.

The tolerance on resistance of the wire at 23 °C shall be in accordance with ISO 8085-3, as follows:

Maximum limit: stated value +10 % + 0,1 Ω.

Minimum limit: stated value –10 %.

8 Requirements for pressure reduction factors

The pressure reduction factors given in table 8 apply to pipe fittings that are used at temperatures above 20 °C for the conveyance of water which do not have adverse effects on the performance of the pipe fittings. The working pressure at elevated temperature shall be obtained by multiplying the nominal pressure given in table 1 to table 5 (inclusive), with the pressure reduction factors given in table 8.

Table 8 — Pressure reduction factors

1	2	3	4	5	6	7	8
Operating temperature (°C)	0 < t ≤ 20	20 < t ≤ 30	30 < t ≤ 40	40 < t ≤ 50	50 < t ≤ 60	60 < t ≤ 70	70 < t ≤ 80
Pressure reduction factors	1	0,95	0,89	0,83	0,77	0,72	0,67

9 Requirements for mechanical characteristics

9.1 General

The pressure bearing capacity of the pipe fittings shall be determined according to annex A.

9.2 Hydrostatic and decohesive strength

9.2.1 The hydrostatic test and burst test shall be conducted in accordance with SANS 130-1. The pipe fittings shall comply with the requirements given in table 9. **Amdt 1**

9.2.2 The hydrostatic test and burst test shall be conducted on a piping assembly (figure 8 gives an example of the assembly for testing 45° bend). The mechanical characteristics of the fittings, which are revealed by the performance of the assembly, shall comply with table 9.

9.2.3 The peel decohesion test shall be conducted on a pipe assembly joined with electrofusion coupler. The test method is given in ISO 13954. The pipe fittings shall comply with the requirements given in table 9.

Table 9 — Mechanical performance tests

1	2	3
Test	Test parameters	Requirements
Hydrostatic strength at 20 °C (100 h)	Test pressure $PN \times 1,6$ (bar)	No failure, no leakage
Hydrostatic strength at 80 °C (165 h)	Test pressure $PN \times 1,6 \times 0,67$ (bar)	No failure, no leakage
Burst test	Instantly increase test pressure to burst pressure	Burst pressure $\geq PN \times 3$
Peel decohesion test	Test temperature 20 °C	Percentage of brittle failure decohesion $\leq 33,3$

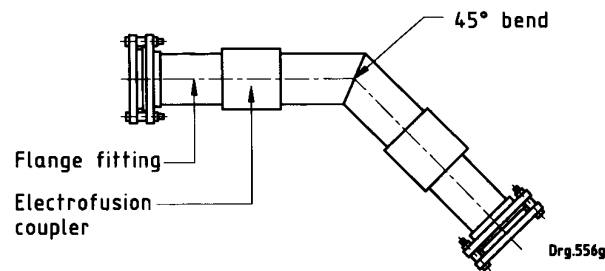


Figure 8 — Test assembly for 45° bend

10 Requirements for physical characteristics

10.1 Thermal stability of pipe fittings manufactured from PE 63 and PE 80

When determined in accordance with an acceptable method, the induction time for test specimens taken from pipe fittings manufactured from PE 63 and PE 80 shall be either at least 20 min when tested at 200 °C, or an equivalent period when tested at 210 °C, provided the equivalence is supported by a clear correlation between results obtained at 200 °C or 210 °C respectively. The test specimens shall be taken from the inside surface of the pipe fitting. **Amdt 1**

10.2 Weathering of non-black pipe fittings

10.2.1 General

When the pipe fittings are manufactured using non-black compound, the effect of weathering shall be determined in accordance with the procedure given in 10.2.2. After exposure to a total solar energy of at least 3,5 GJ/m², the pipe fitting shall comply with the following requirements:

- the mechanical characteristics shall meet the requirements given in table 9; and
- the induction time, when measured in accordance with an acceptable method, shall be at least 10 min at 200 °C. **Amdt 1**

SANS 371:2009

Edition 1.1

10.2.2 Procedure for exposure to outdoor weathering

10.2.2.1 Exposure aspects and site

Test racks and specimen fixtures shall be made from inert materials which will not affect the test results. Wood, non-corrosive aluminium alloys, stainless steel or ceramics have been found suitable. Brass, steel or copper shall not be used in the vicinity of test specimens. The test site shall be equipped with instruments to record the solar energy received and the ambient temperature.

The equipment shall be capable of supporting specimens of pipe fitting such that the exposed surface of the specimens is at 45° to the horizontal, facing towards the equator. Normally, the exposure site shall be an open ground well away from trees and buildings. For exposure in the northern hemisphere, no obstruction, including adjacent racks, in an easterly, southerly or westerly direction shall subtend a vertical angle greater than 20°, or in a northerly direction greater than 45°. For exposure in the southern hemisphere, corresponding provisions apply.

10.2.2.2 Test specimens

Test specimens shall be taken from internal wall of the pipe fittings within a random range of diameters. The batch of pipe fittings from which the specimens are selected shall comply with the requirements of this standard.

10.2.2.3 Procedure

10.2.2.3.1 Mark each specimen to identify it, and record the mounting position of each.

10.2.2.3.2 Expose the specimens to a total solar energy of at least 3,5 GJ/m².

10.2.2.3.3 Remove the specimens and test them in accordance with the clause 10.2.1. Where the specimen to be tested includes only part of the fitting cross-section, e.g. a tensile dumb-bell or part of the surface layer, it shall be taken from the weathered crown of the exposed specimen.

11 Packing, transportation and storage

11.1 Packing

The pipe fittings shall be first sealed in plastic bags, singly or in bulk, then packed in wooden or other type cases to avoid being damaged. Conformity certificate issued by quality control section shall be enclosed.

11.2 Transportation

Scratching, dropping pipe fittings onto hard surfaces and severe impact on or between the pipe fittings shall be avoided during transportation and handling. Measures shall be taken to protect the fittings from direct sunlight, rain or contamination.

11.3 Storage

The pipe fittings shall be kept far away from heat sources, and the ambient temperature shall not exceed 40 °C. The warehouse shall be well ventilated and the stack bed shall be flat and clean.

12 Marking

The marking shall be maintained for the life of the pipe fitting, and shall be so applied as not to adversely affect the fitting performance and far away from the observation holes.

If printing is used, the colouring of the printed information shall differ from the basic colouring of the fitting. The size of the marking shall be such that it is easily legible without magnification. All pipe fittings shall be marked with the minimum information as given below:

- a) the standard number SANS 371 (see foreword);
- b) the manufacturer's name or trademark (or both);
- c) nominal internal diameter;
- d) nominal pressure;
- e) PE designation; and
- f) production date.

SANS 371:2009
Edition 1.1

Annex A
(normative)

Pressure and structural design of the pipe fittings

A.1 Load (hoop stress) sharing in the pipe fitting

When the pipe fitting works under nominal pressure, it should be within elastic limits. In the pipe, fitting the steel plate and plastics deform as a single unit, and therefore, experience equal strains. Thus, the following formula can be obtained:

$$\varepsilon_s = \frac{\sigma_s}{E_s} \quad \varepsilon_p = \frac{\sigma_p}{E_p} \quad (1) \quad \frac{\sigma_p}{\sigma_s} = \frac{E_p}{E_s} = K \quad (2)$$

where

- ε_s is the average strain of steel mesh;
- ε_p is the average strain of PE;
- σ_s is the average stress of steel wires, in megapascals;
- σ_p is the average stress of PE, in megapascals;
- E_s is the elastic modulus of steel mesh, in megapascals;
- E_p is the elastic modulus of PE, in megapascals;
- K is a constant.

The above expression shows that within the elastic limit there is a fixed relationship between the load sustained by the plastics and that by the steel, i.e. the elastic modulus ratio between the plastics and the steel. The elastic modulus of steel is more than 200 times that of plastics, thus when the pipe fitting is subject to nominal pressure, the plastics only sustains a minor percent of the total stress, which is far below its allowable stress.

A.2 Formula for calculating maximum operating pressure (MOP) of the pipe fitting

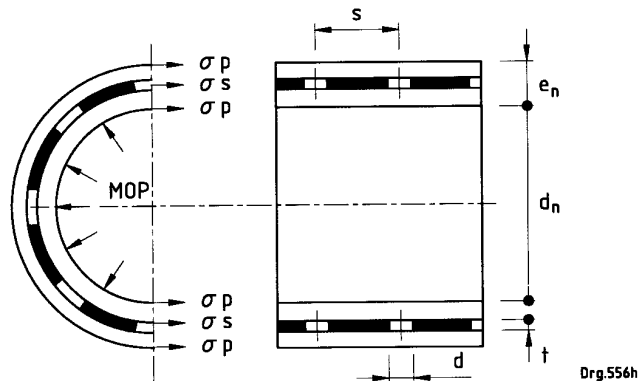


Figure A.1 — Cross-section in maximum hoop stress direction

According to figure A.1, the following equation can be obtained:

$$MOP \times d_n \times s = 2[(s - d)\sigma_t s + \sigma_p(e_n - t)s] \quad (3)$$

By combining formula (2) and (3), the following formula is achieved:

$$MOP = \frac{2[\sigma_s t(s - d) + \sigma_p s(e_n - t)]}{d_n s} \geq PN \quad (4)$$

where

PN is the nominal pressure of the pipe fitting, in megapascals;

MOP is the maximum operating pressure of the pipe fitting, in megapascals;

d_n is the nominal diameter of the pipe fitting, in millimetres;

e_n is the nominal wall thickness of the pipe fitting, in millimetres;

σ_s is the standard allowable stress of steel mesh (normally one third of the tensile limit of the steel plate adopted);

σ_p is the design stress of PE ($K\sigma_s$);

t is the thickness of the steel plate, in millimetres;

s is the distance between two adjacent holes in longitudinal direction, in millimetres;

d is the diameter of the perforated holes in the steel plate, in millimetres.

In the above expression, the values of d_n , e_n , s and d are predetermined according to the pipe fitting series and the manufacturing process. Based on this predetermination, the materials for making the steel plate and PE designation shall be selected. Make calculations according to this method by adjusting the value of s to find a proper value for s , with which the required maximum working pressure MOP and safety factor n can be achieved. Finally, round the calculated MOP to obtain the nominal pressure PN .

A.3 Structural and pressure design of the pipe fittings

The procedure for structural and pressure design of the pipe fittings is given in figure A.2. When making verification to the calculation results with actual burst test data, the criterion can be $P_b/PN \geq 3$ ¹⁾.

1) $P_b/PN \geq 3$ is used to further verify the correctness of the calculation results and the safety degree.
 $MOP = P_b$ is not mentioned.

SANS 371:2009
Edition 1.1

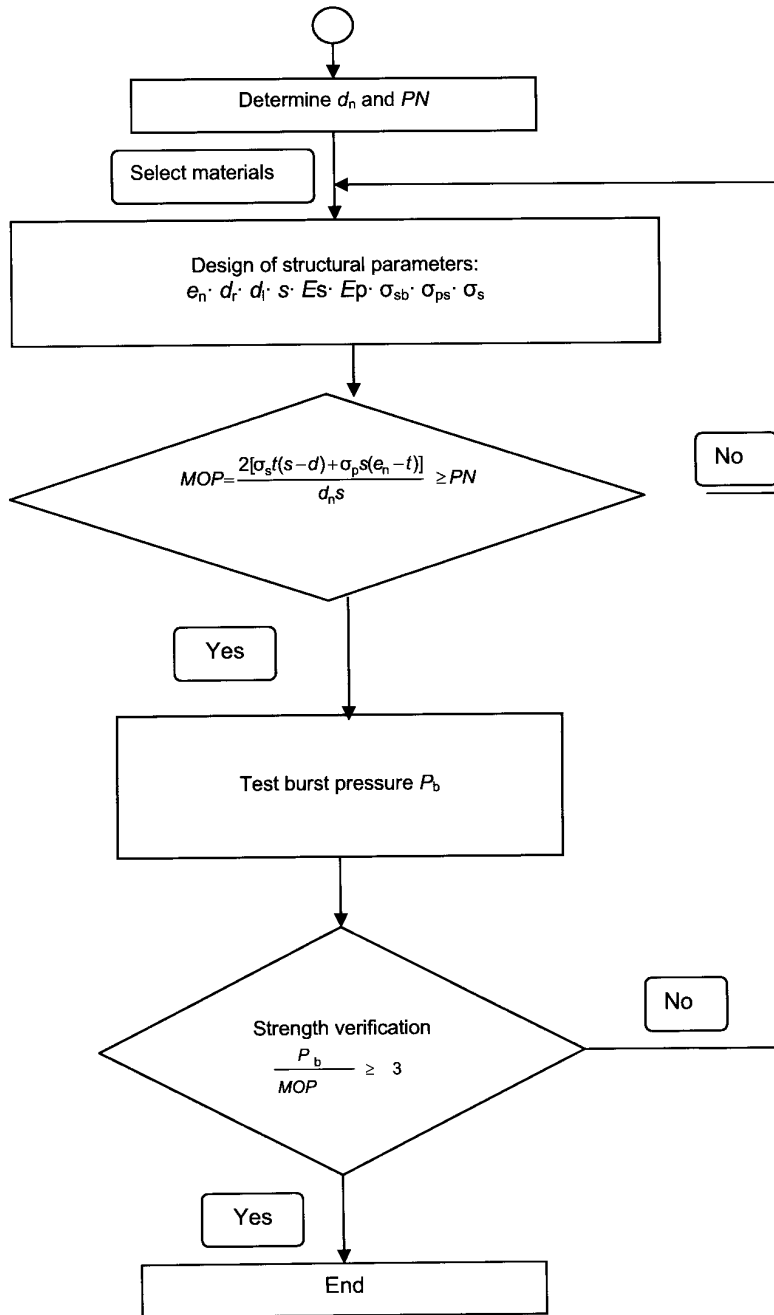


Figure A.2 — Procedure for structural pressure design of the pipe fitting

Annex B
(informative)

**Quality verification of steel mesh reinforced polypropylene (PE)
pipe fittings for water supply**

When a purchaser requires ongoing verification of the quality of steel mesh reinforced polypropylene pipe fittings for water supply, it is suggested that instead of concentrating solely on evaluation of the final product, he also direct his attention to the manufacturer's quality system. In this connection it should be noted that SANS 9001 covers the provision of an integrated quality system.

Bibliography

- EN 1092-1, *Flanges and their joints – Circular flanges for pipes valves, fittings and accessories, PN designated – Part 1: Steel flanges.* **Amdt 1**
- ISO 1183-1, *Plastics – Methods for determining the density of non-cellular plastics – Part 1: Immersion method, liquid pycnometer method and titration method.*
- ISO 1183-2, *Plastics – Methods for determining the density of non-cellular plastics – Part 2: Density gradient column method.*
- ISO 1183-3, *Plastics – Methods for determining the density of non-cellular plastics – Part 3: Gas pycnometer method.*
- ~~ISO 3663, Polyethylene (PE) pressure pipes and fittings, metric series – Dimensions of flanges.~~ **Amdt 1**
- ~~ISO 4427, Polyethylene (PE) pipes for water supply – Specifications.~~ **Amdt 1**
- ISO 7005-1, *Metallic flanges – Part 1: Steel flanges.*
- ISO 9969, *Thermoplastics pipes – Determination of ring stiffness.*
- ISO 13761, *Plastics pipes and fittings – Pressure reduction factors for polyethylene pipeline systems for use at temperatures above 20 °C.*
- SANS 966-1, *Components of pressure pipe systems – Part 1: Unplasticized poly(vinyl chloride) (PVC-U) pressure pipe systems.*
- SANS 4427-1/ISO 4427-1, *Plastics piping systems – Polyethylene (PE) pipes and fittings for water supply – Part 1: General.* **Amdt 1**
- SANS 4427-2/ISO 4427-2, *Plastics piping systems – Polyethylene (PE) pipes and fittings for water supply – Part 2: Pipes.* **Amdt 1**
- SANS 4427-3/ISO 4427-3, *Plastics piping systems – Polyethylene (PE) pipes and fittings for water supply – Part 3: Fittings.* **Amdt 1**

SANS 371:2009

Edition 1.1

SANS 4427-5/ISO 4427-5, *Plastics piping systems – Polyethylene (PE) pipes and fittings for water supply – Part 5: Fitness for purpose of the system.* **Amdt 1**

SANS 4437/ISO 4437, *Buried polyethylene (PE) pipes for the supply of gaseous fuels – Metric series – Specifications.* **Amdt 1**

SANS 9001/ISO 9001, *Quality management systems – Requirements.*

SANS 10112, *The installation of polyethylene and poly(vinyl chloride) (PVC-U and PVC-M) pipes.*

© SABS

SABS – Standards Division

The objective of the SABS Standards Division is to develop, promote and maintain South African National Standards. This objective is incorporated in the Standards Act, 2008 (Act No. 8 of 2008).

Amendments and Revisions

South African National Standards are updated by amendment or revision. Users of South African National Standards should ensure that they possess the latest amendments or editions.

The SABS continuously strives to improve the quality of its products and services and would therefore be grateful if anyone finding an inaccuracy or ambiguity while using this standard would inform the secretary of the technical committee responsible, the identity of which can be found in the foreword.

Tel: +27 (0) 12 428 6666 Fax: +27 (0) 12 428 6928

The SABS offers an individual notification service, which ensures that subscribers automatically receive notification regarding amendments and revisions to South African National Standards.

Tel: +27 (0) 12 428 6883 Fax: +27 (0) 12 428 6928 E-mail: sales@sabs.co.za

Buying Standards

Contact the Sales Office for South African and international standards, which are available in both electronic and hardcopy format.

Tel: +27 (0) 12 428 6883 Fax: +27 (0) 12 428 6928 E-mail: sales@sabs.co.za

South African National Standards are also available online from the SABS website <http://www.sabs.co.za>

Information on Standards

The Standards Information Centre provides a wide range of standards-related information on both national and international standards, and is the official WTO/TBT enquiry point for South Africa. The Centre also offers an individual updating service called INFOPLUS, which ensures that subscribers automatically receive notification regarding amendments to, and revisions of, international standards.

Tel: +27 (0) 12 428 6666 Fax: +27 (0) 12 428 6928 E-mail: info@sabs.co.za

Copyright

The copyright in a South African National Standard or any other publication published by the SABS Standards Division vests in the SABS. Unless exemption has been granted, no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means without prior written permission from the SABS Standards Division. This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any purpose other than implementation, prior written permission must be obtained.

Details and advice can be obtained from the Senior Manager.

Tel: +27 (0) 12 428 6666 Fax: +27 (0) 12 428 6928 E-mail: info@sabs.co.za

THESE ARE THE TERMS AND CONDITIONS OF THE SALE OF THE GOODS...

THE BUYER SHALL BE RESPONSIBLE FOR THE PAYMENT OF THE GOODS...

THE SELLER SHALL BE RESPONSIBLE FOR THE DELIVERY OF THE GOODS...

THE BUYER SHALL BE RESPONSIBLE FOR THE RECEIPT OF THE GOODS...

THE SELLER SHALL BE RESPONSIBLE FOR THE QUALITY OF THE GOODS...

THE BUYER SHALL BE RESPONSIBLE FOR THE STORAGE OF THE GOODS...

THE SELLER SHALL BE RESPONSIBLE FOR THE PACKAGING OF THE GOODS...

THE BUYER SHALL BE RESPONSIBLE FOR THE UNLOADING OF THE GOODS...

THE SELLER SHALL BE RESPONSIBLE FOR THE DELIVERY OF THE GOODS...

THE BUYER SHALL BE RESPONSIBLE FOR THE PAYMENT OF THE GOODS...

THE SELLER SHALL BE RESPONSIBLE FOR THE DELIVERY OF THE GOODS...

Draft for comments only — Not to be cited as East African Standard